




**TRANE®**

## Integration Guide

# BACnet® Integration to IntelliPak® Rooftop Units

## With Symbio™ 800 Controls

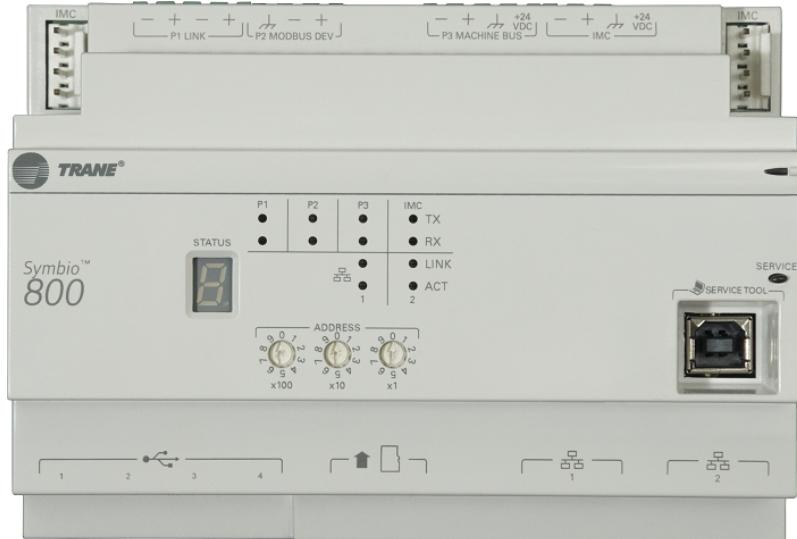

### **⚠ SAFETY WARNING**

Only qualified personnel should install and service the equipment. The installation, starting up, and servicing of heating, ventilating, and air-conditioning equipment can be hazardous and requires specific knowledge and training. Improperly installed, adjusted or altered equipment by an unqualified person could result in death or serious injury. When working on the equipment, observe all precautions in the literature and on the tags, stickers, and labels that are attached to the equipment.

February 2023

**ACC-SVP02F-EN**

**TRANE**  
TECHNOLOGIES™



## Introduction

Read this manual thoroughly before operating or servicing this unit.

## Warnings, Cautions, and Notices

Safety advisories appear throughout this manual as required. Your personal safety and the proper operation of this machine depend upon the strict observance of these precautions.

The three types of advisories are defined as follows:



### WARNING

Indicates a potentially hazardous situation which, if not avoided, could result in death or serious injury.



### CAUTION

Indicates a potentially hazardous situation which, if not avoided, could result in minor or moderate injury. It could also be used to alert against unsafe practices.

### NOTICE

Indicates a situation that could result in equipment or property-damage only accidents.

## Important Environmental Concerns

Scientific research has shown that certain man-made chemicals can affect the earth's naturally occurring stratospheric ozone layer when released to the atmosphere. In particular, several of the identified chemicals that may affect the ozone layer are refrigerants that contain Chlorine, Fluorine and Carbon (CFCs) and those containing Hydrogen, Chlorine, Fluorine and Carbon (HCFCs). Not all refrigerants containing these compounds have the same potential impact to the environment. Trane advocates the responsible handling of all refrigerants-including industry replacements for CFCs and HCFCs such as saturated or unsaturated HFCs and HCFCs.

## Important Responsible Refrigerant Practices

Trane believes that responsible refrigerant practices are important to the environment, our customers, and the air conditioning industry. All technicians who handle refrigerants must be certified according to local rules. For the USA, the Federal Clean Air Act (Section 608) sets forth the requirements for handling, reclaiming, recovering and recycling of certain refrigerants and the equipment that is used in these service procedures. In addition, some states or municipalities may have additional requirements that must also be adhered to for responsible management of refrigerants. Know the applicable laws and follow them.



### Proper Field Wiring and Grounding Required!

Failure to follow code could result in death or serious injury.

All field wiring **MUST** be performed by qualified personnel. Improperly installed and grounded field wiring poses FIRE and ELECTROCUTION hazards. To avoid these hazards, you **MUST** follow requirements for field wiring installation and grounding as described in NEC and your local/state/national electrical codes.

**⚠ WARNING****Personal Protective Equipment (PPE) Required!**

Failure to wear proper PPE for the job being undertaken could result in death or serious injury. Technicians, in order to protect themselves from potential electrical, mechanical, and chemical hazards, MUST follow precautions in this manual and on the tags, stickers, and labels, as well as the instructions below:

- Before installing/servicing this unit, technicians MUST put on all PPE required for the work being undertaken (Examples; cut resistant gloves/sleeves, butyl gloves, safety glasses, hard hat/bump cap, fall protection, electrical PPE and arc flash clothing). ALWAYS refer to appropriate Safety Data Sheets (SDS) and OSHA guidelines for proper PPE.
- When working with or around hazardous chemicals, ALWAYS refer to the appropriate SDS and OSHA/GHS (Global Harmonized System of Classification and Labelling of Chemicals) guidelines for information on allowable personal exposure levels, proper respiratory protection and handling instructions.
- If there is a risk of energized electrical contact, arc, or flash, technicians MUST put on all PPE in accordance with OSHA, NFPA 70E, or other country-specific requirements for arc flash protection, PRIOR to servicing the unit. NEVER PERFORM ANY SWITCHING, DISCONNECTING, OR VOLTAGE TESTING WITHOUT PROPER ELECTRICAL PPE AND ARC FLASH CLOTHING. ENSURE ELECTRICAL METERS AND EQUIPMENT ARE PROPERLY RATED FOR INTENDED VOLTAGE.

**⚠ WARNING****Follow EHS Policies!**

Failure to follow instructions below could result in death or serious injury.

- All Trane personnel must follow the company's Environmental, Health and Safety (EHS) policies when performing work such as hot work, electrical, fall protection, lockout/tagout, refrigerant handling, etc. Where local regulations are more stringent than these policies, those regulations supersede these policies.
- Non-Trane personnel should always follow local regulations.

## Copyright

This document and the information in it are the property of Trane, and may not be used or reproduced in whole or in part without written permission. Trane reserves the right to revise this publication at any time, and to make changes to its content without obligation to notify any person of such revision or change.

## Trademarks

All trademarks referenced in this document are the trademarks of their respective owners.

## Revision History

- Updated all tables in Object Data Points and Diagnostic Data Points section.



# Table of Contents

Overview .....	5
Purpose .....	5
Symbio™ 800 Controller Overview .....	5
Communication Options .....	5
Units of Measure.....	5
Communication Setup and Configuration.....	6
Service Tool for Symbio™ 800 Configuration .....	6
Connecting to the Symbio™ 800 Web Interface .....	6
BACnet Protocol Configuration .....	8
BACnet MS/TP Protocol Settings .....	8
BACnet IP (Ethernet or Wi-Fi connectivity) .....	9
Manually Change Symbio™ 800 BACnet Device ID.....	12
Air-Fi® Wireless .....	14
Points List .....	15
Object Naming Conventions.....	15
Object Data Points and Diagnostic Data Points .....	15
Recycled Points .....	45
Arbitration .....	A-1
Symbio™ 800 Controller Layout .....	B-1



# Overview

## Purpose

The purpose of this document is to provide instructions for integrating the Symbio™ 800 controller into building automation systems. This document is targeted to system integrators and controls contractors.

## Symbio™ 800 Controller Overview

The Symbio™ 800 controller has been installed, programmed, wired, and tested in the factory prior to shipment. While some sensors and end devices are normally wired in the field, nearly all other wiring is factory-provided. Power for the controller is provided and connected from within the RTU control panel.

The RTU and associated controller can be applied as standalone or as part of a building automation system.

**Note:** For communicating applications to third-party control systems, network communication wiring must be provided by others.

## Communication Options

The Symbio™ 800 controller supports the following communication protocol options for integration to either Trane or Non-Trane control systems:

- BACnet MS/TP
- BACnet Zigbee (Air-Fi)®
- BACnet IP
  - Ethernet
  - Wi-Fi
- Modbus RTU
- Modbus TCP
- LonTalk®

For information pertaining to the integration of the Symbio™ 800 controller using either BACnet® or LonTalk® communication, refer to ACC-SVP02\*-EN (BACnet) and BAS-SVP039\*-EN (LonTalk).

## Units of Measure

The communicated data of the Symbio™ 800 controller will be passed in the factory-configured units of measure, either inch-pound (I-P) or the International System of Units (SI). The units of measure are selected as part of the unit order (the default selection is normally I-P). Should the units of measure need to be changed in the field, contact your local Trane representative.

The Symbio™ 800 controller provides a browser-based user interface for USB connection to the controller. One of the tools provided with that interface allows the user to change and customize the Data Display Units Preferences.

**Important:** These adjustable settings are applied only to the units of measured displayed in the web interface, not the communicated interface.


Regardless of the communicated (system) units of measure, the user may change the displayed units of measure on their smart device. These user preference units of measure are independent of the communicated units.



# Communication Setup and Configuration

The Symbio™ 800 controller can be factory ordered with a specific protocol configuration and rotary address setting. If communication options were not specified, the Symbio™ 800 controller will be setup for BACnet MS/TP communications at 76,800 bps with a rotary address setting of 000.

**Figure 1. Symbio™ 800 rotary address and service tool port**

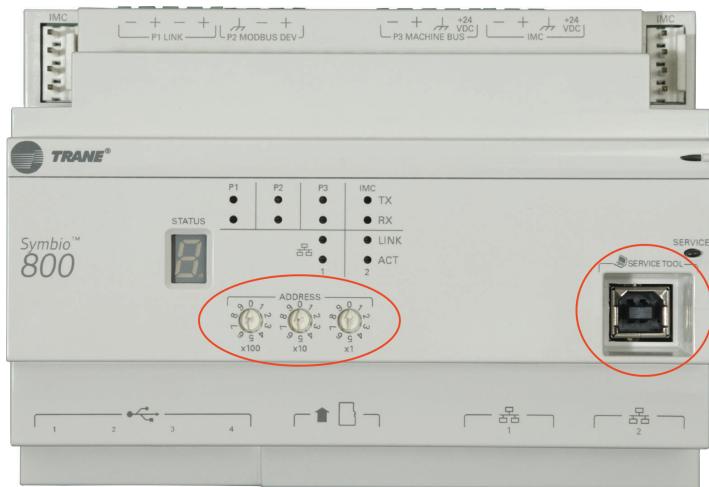


## Service Tool for Symbio™ 800 Configuration

The service tool used to modify the Symbio™ 800 controller is a standard web browser. The Symbio™ 800 webpage is accessed by using a standard USB type A/B cable. Connect the USB cable between a laptop and the service tool port on the Symbio™ 800 controller (shown in Figure 1, p. 6).

## Connecting to the Symbio™ 800 Web Interface

1. Connect a laptop to the Symbio™ 800 controller using a USB cable.
2. On the laptop, open a web browser to <http://198.80.18.1/>
3. When the Symbio™ 800 page displays, click **Log In**.

Figure 2. Symbio™ 800 log in screen

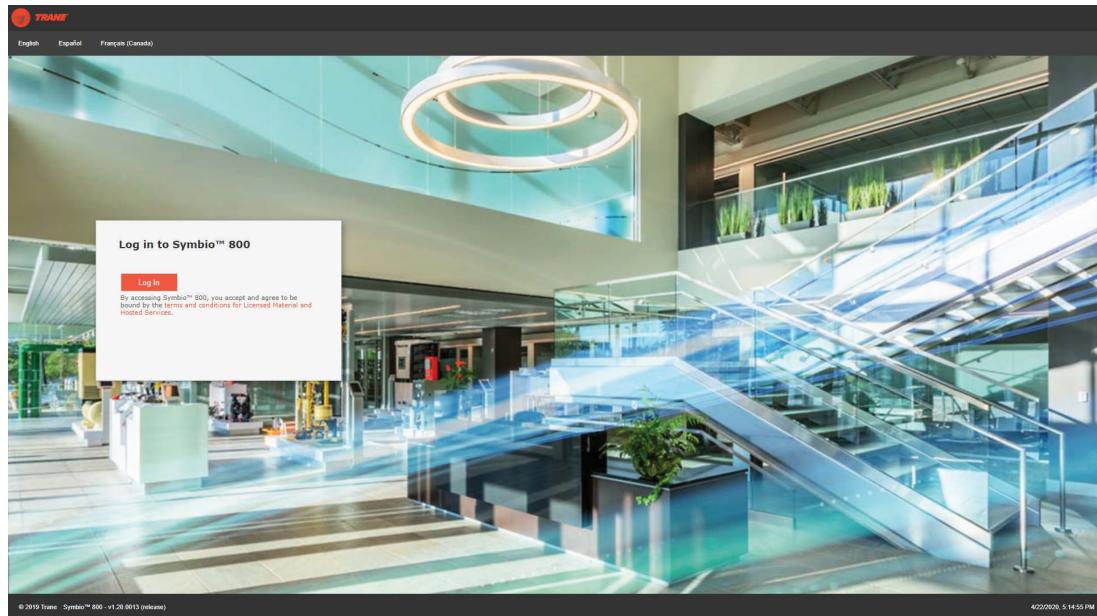

**Note:** The Symbio™ 800 web interface can only be viewed using the USB connection. Ethernet port 1 and Ethernet port 2 will not allow access to the Symbio™ web server to meet IT security requirements.



# BACnet Protocol Configuration

To access the Symbio™ 800 Protocol Configuration page:

1. Connect to the Symbio™ 800 web interface.
2. On the left-hand navigation, click **Installation**.
3. Click **Identification and Communications**.

**Figure 3. Identification and Communications**

The screenshot shows the 'Identification and Communications' section of the Symbio 800 configuration interface. It includes a table of tasks and their descriptions, with the 'Identification and Communications' row highlighted.

Task	Description
Regional Specifications	Change the time zone, date, and time.
Symbio 800 System Units	View the Symbio 800 system units.
<a href="#">Identification and Communications</a>	Change and specify equipment name, location name, BACnet addressing, IP addressing and Network Connectivity settings for the Symbio 800.
USB Ports and microSD	View USB Ports and microSD status and safely unmount devices.
Licensing	License the Symbio 800.

4. Click the **Protocol Configuration** tab.

**Figure 4. Protocol Configuration**

The screenshot shows the 'Protocol Configuration' tab selected within the 'Identification and Communications' section. The tab bar also includes 'Symbio 800 Identification', 'Edit', 'Air-Fi Configuration', 'IP Configuration', 'Intelligent Services', and 'Network Connectivity and SSL'.

5. Click **Edit** to change the Protocol Configuration settings. See the sections below for details on editing BACnet MS/TP, BACnet IP, and BACnet Air-Fi protocols.

## BACnet MS/TP Protocol Settings

The rotary address on the Symbio™ 800 controller sets the BACnet MS/TP MAC address. Each BACnet MS/TP device on the same TP link must have a unique MAC address. The valid range of BACnet MS/TP MAC addresses for the Symbio™ 800 is: **001–127**.

**Important:** The Symbio™ 800 controller will disable BACnet MS/TP communications if the rotary address is 000!

Changing the rotary address will immediately take affect and does NOT require a power cycle to the

Symbio™ 800 controller.

The rotary address also sets the BACnet Device ID which gives a range of **1-127**. All BACnet devices must have a unique BACnet Device ID. The Symbio™ 800 BACnet Device ID can also be manually changed using a web browser, the Tracer SC+ system controller, or Tracer TU.

To configure the Symbio™ 800 for BACnet MS/TP protocol: (See the following figure for user interface locations for each step.)

1. Set the System Protocol drop-down to **BACnet MS/TP**.
2. Verify the **Baud Rate** (default is 76,800 bps). All BACnet MS/TP devices on an TP link must communicate at the same baud rate.
3. Verify the **Current Device ID**. To change the device ID, click **Use Software Device ID** and enter the desired device ID. The valid device ID range using a software device ID is 1-4194302 as defined by the BACnet standard.

**Figure 5. BACnet MS/TP protocol settings**



The BACnet MS/TP communication wire is connected to the P1 Link. Observe wire polarity when connecting to the + and – terminals. The + terminals and the – terminals are internally connected. The second set of + and – terminals on the P1 Link are used to make it easier to wire the next BACnet MS/TP device in the daisy chain.

Refer to the BACnet standard or BACnet® MS/TP Wiring and Link Performance Best Practices and Troubleshooting guide BAS-SVX51\*-EN for detailed information on TP wiring.

## BACnet IP (Ethernet or Wi-Fi connectivity)

The Symbio™ 800 controller can communicate BACnet IP using a standard Ethernet cable or using Wi-Fi (with the optional USB to Wi-Fi adapter).

If using BACnet IP using a standard Ethernet cable, connect the Ethernet cable with RJ-45 connectors to Ethernet port 1 and the BACnet network. If using BACnet IP communication using Wi-Fi, the optional USB to Wi-Fi adapter should be connected to one of the USB ports.

**Note:** It is strongly recommended to only use the Ethernet 1 connection or the Wi-Fi adapter.

Set up the IP address of the Symbio™ 800 controller before changing other BACnet IP configuration parameters.

1. On the Identification and Communications page, click the **IP Configuration** tab.

**Figure 6. IP configuration tab**



2. Click **Edit**.



## BACnet Protocol Configuration

Figure 7. Edit IP configuration

### Identification and Communications

< Installation    **Edit**

Symbio 800 Identification    Protocol Configuration    Air-Fi Configuration    **IP Configuration**    Intelligent Services    Network Connectivity and SSL

**Host Name**    Symbio-E18L01166

**Ethernet 1**

Obtain IP Address Automatically using DHCP  
 Use the following IP address

IP Address    192 . 168 . 4 . 15  
Subnet Mask    255 . 255 . 255 . 0  
Default Gateway    192 . 168 . 4 . 1

**Ethernet 2 (Connection to TD-7 operator display)**

IP Address    198 . 80 . 18 . 9  
Subnet Mask    255 . 255 . 255 . 252

3. For BACnet IP using Ethernet cable connection only:
  - a. Setup the Ethernet 1 port to either **Obtain an IP Address Automatically using DHCP** or use a static IP address by manually entering the IP address, subnet mask, and default.
  - b. Set the Preferred IP Interface to **Ethernet 1**.
  - c. Setup the DNS section if using a Domain Name System server to identify the Symbio™ 800 controller by host name.
4. For BACnet IP using the Wi-Fi connection only:
  - a. Check **Enable the Wi-Fi network connection** and click **Save**.

**Figure 8. Enable Wi-Fi network connection**

Identification and Communications

< Installation Edit

Symbio 800 Identification Protocol Configuration Air-Fi Configuration IP Configuration Intelligent Services Network Connectivity and SSL

Host Name Symbio-E18L01166

Ethernet 1

Obtain IP Address Automatically using DHCP  
 Use the following IP address

IP Address 192 . 168 . 4 . 15  
Subnet Mask 255 . 255 . 255 . 0  
Default Gateway 192 . 168 . 4 . 1

Ethernet 2 (Connection to TD-7 operator display)

IP Address 198 . 80 . 18 . 9  
Subnet Mask 255 . 255 . 255 . 252

Wi-Fi Network

Enable the Wi-Fi network connection

Preferred IP Interface

Ethernet 1  
 Wi-Fi Network

Save Cancel



b. Click **Wi-Fi Setup**.

**Figure 9. Wi-Fi setup**

Identification and Communications

< Installation Edit

Symbio 800 Identification Protocol Configuration Air-Fi Configuration IP Configuration Intelligent Services Network Connectivity and SSL

Host Name Symbio-E20A01392

Ethernet 1

Method for Obtaining IP Address	Specified Static address used
MAC Address	00:12:EA:0E:B2:B3
IP Address	193.168.1.100
Subnet Mask	255.255.255.0

Ethernet 2 (Connection to TD-7 operator display)

IP Address	198.80.18.9
Subnet Mask	255.255.255.252

Wi-Fi Network

Port State	Enabled
Method for Obtaining IP Address	Specified Static address used
MAC Address	00:23:A7:F6:6A:80
IP Address	198.80.18.65
Subnet Mask	255.255.255.192
Default Gateway	...

Wi-Fi Host Status

Device Name	IP Address	MAC Address
-------------	------------	-------------

Wi-Fi Setup

- c. Click **Client Mode (Station)** to join an existing Wi-Fi access point. Click **Next**.
- d. Select the Wi-Fi network or type the SSID of the hidden access point. Click **Next**.
- e. Enter the security parameters for the chosen access point. Contact the local IT administrator of



## BACnet Protocol Configuration

- the chosen access point for security parameters.
- f. Click **Finish** and verify connectivity to the access point.
  - g. Set the Preferred IP Interface to **Wi-Fi Network**.
  - h. Setup the DNS section if using a Domain Name System server to identify the Symbio™ 800 controller by host name.

### Manually Change Symbio™ 800 BACnet Device ID

The rotary address on the Symbio™ 800 controller sets the BACnet Device ID which gives a range of **1-999**. All BACnet devices must have a unique BACnet Device ID. The Symbio™ 800 BACnet Device ID can also be manually changed using a web browser or the Tracer SC+ system controller.

**Figure 10. Protocol configuration**

The screenshot shows the 'Protocol Configuration' tab selected under 'System Protocol'. The 'BACnet/IP' option is chosen. In the 'Device ID Information' section, the current device ID is set to 4. There is a checkbox for 'Use Software Device ID' which is unchecked. In the 'Advanced' section, the BACnet Segment Timeout is set to 5000, the APDU Timeout is set to 10000, and the APDU Retries are set to 3. Under 'BACnet/IP Configuration', the network connection is set to 'Ethernet 1'. The UDP port is set to 47808 and BBMD is unchecked.

1. Set the System Protocol drop down to **BACnet IP**.
2. Verify the current Device ID. To change the Device ID, click **Use Software Device ID** and enter the desired Device ID. Most installations will not need to manually change the BACnet Device ID.  
**Note:** The valid Device ID range using a software Device ID is 1 – 4194302 as defined by the BACnet standard.
3. If using an Ethernet cable, set the Network Connection to **Ethernet 1**. If using the USB to Wi-Fi adapter, set the Network Connection to **Wi-Fi**.

**Figure 11.** Network connection

Identification and Communications

**BACnet Configuration**

**Device ID Information**

Current Device ID	4
Rotary Dial Setting	4
<input type="checkbox"/> Use Software Device ID	4

**Advanced**

BACnet Segment Timeout	5000
BACnet APDU Timeout	10000
BACnet APDU Retries	3

**BACnet/IP Configuration**


**Network Connection**

Ethernet 1	Ethernet 1
Wi-Fi	47808
UDP Port	<input type="checkbox"/> BBMD

**LON Settings**

Adapter Connection Status	Not Connected
Neuron ID	...
Link Status	...
<b>Service Pin</b>	

**Save** **Cancel**

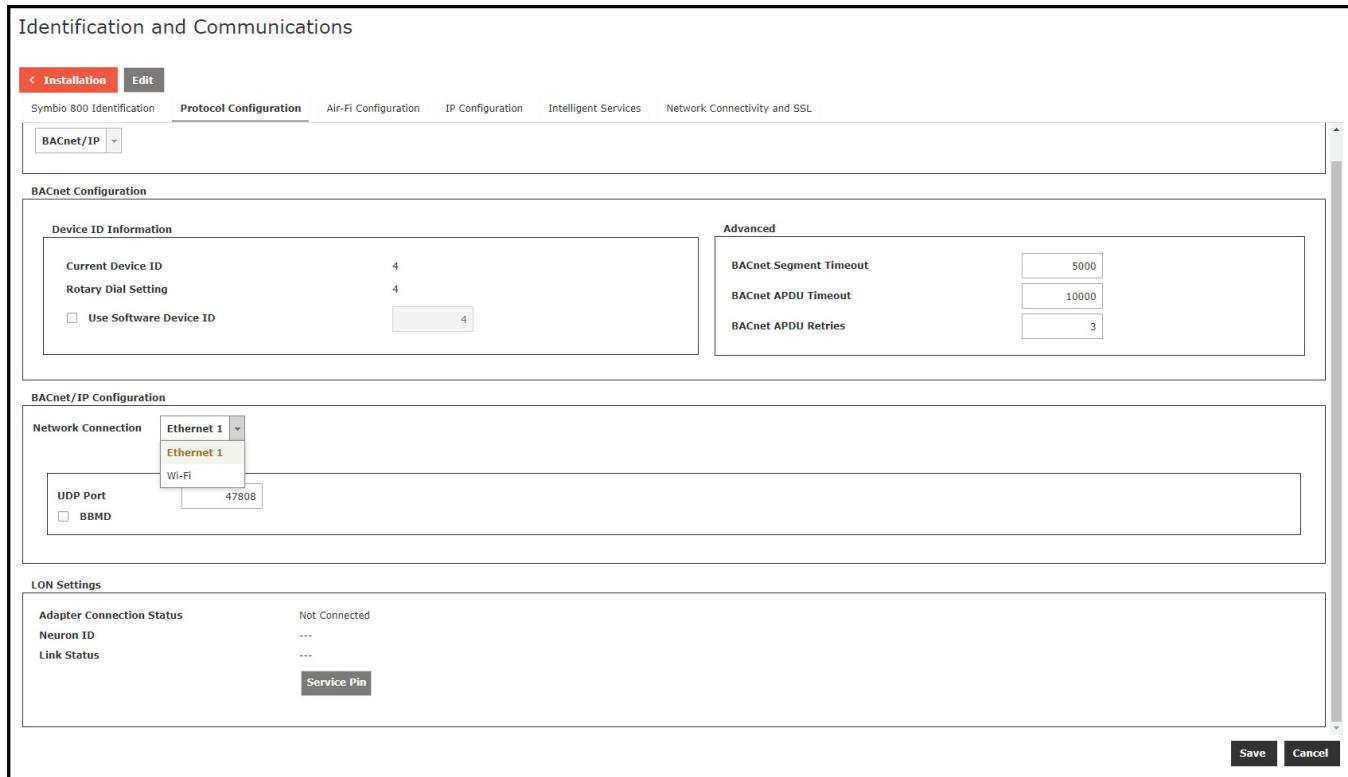

4. Set the UDP Port to match the port number used by the BACnet IP network. The default is 47808.
5. Check the BBMD checkbox only if the Symbio™ 800 controller is the only BACnet IP device on the IP subnet.
  - a. If a change to the BBMD checkbox was made, click **Save** and refresh the web browser. If BBMD functionality is enabled, the BDT setup button displays.


**Figure 12.** BDT setup

**BACnet/IP Configuration**

**Network Connection**    **Ethernet 1**

UDP Port	47808
BBMD	Enabled

**BDT Setup**

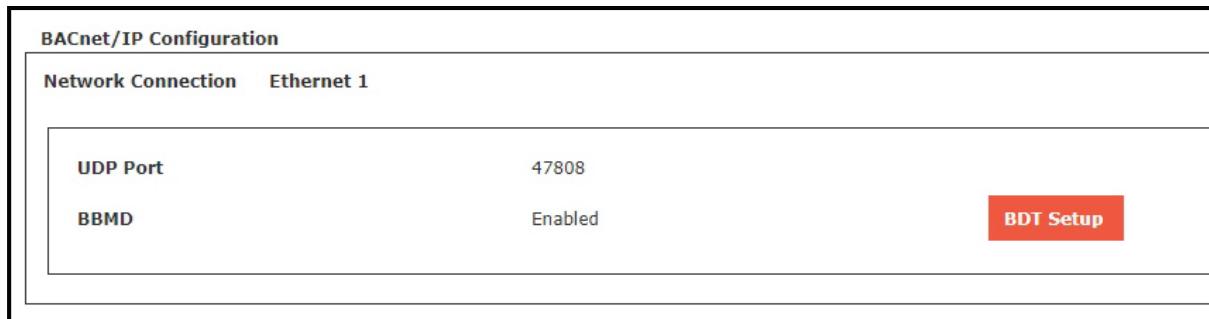

- b. If BBMD functionality is enabled, click **BDT Setup** to set up the BACnet Distribution Table (BDT). The IP addresses of all BBMDs in the BACnet intranetwork should be in the BDT, and all BBMDs should have the same BDT entries.

**Important:** A strong knowledge of BACnet networking is needed to properly setup BBMD and BDT functionality.

For additional information on BBMDs and BDTs, refer to the BACnet specification or your local Trane office.



## BACnet Protocol Configuration

---

### Air-Fi® Wireless

Air-Fi Wireless – Conforms to ANSI/ASHRAE Standard 135-2016 (BACnet®/ZigBee®<sup>1</sup>). Air-Fi Wireless provides reliable and secure, and location-flexible communication between equipment controls, sensors, and service tools to the system controller.

Air-Fi networks will be setup by a Trane technician. Integration to a Symbio™ 800 controller setup for Air-Fi communications uses BACnet IP communication through a Tracer SC+ system controller. Contact your local Trane office for additional information if the Symbio™ 800 controller is setup for Air-Fi Wireless.

---

<sup>1</sup>. ZigBee is a registered trademark of the ZigBee Alliance.



# Points List

## Object Naming Conventions

The communicated points for the Symbio™ controllers are generally named according to their function. While many of the points are read-only, others include both read and write capability. The established naming convention helps to identify the capabilities of each point. For most points, the suffix identifies the capability according to the following definition.

While there are some exceptions, the majority of the points have been defined according to these guidelines.

Suffix	Description
Status	Points with the Status suffix are defined as read-only. The status point reports the value being used by the controller.
Local	Points with the Local suffix are defined as read-only. The local point reports values associated with controller sensors, both wired and wireless. The local value may or may not be actively used by the controller, depending on the presence or absence of a communicated value (BAS). When both a local and communicated value exist, the communicated value is used.
Active	Points with the Active suffix are defined as read-only. Points designated as active are normally the result of the arbitration between a communicated value(BAS) and at least one value local to the equipment, such as a sensor or default setpoint. The active point reports the value being input to the controller.
Setpoint	Points with the Setpoint suffix are defined as either read-only or read/write. For BACnet, the binary input, analog input and multi-state input points are all read-only. These setpoints report the value currently in use by the controller. The analog value, binary value and multi-state value points are all read/write. These points are provided for use by the building automation system (BAS). When used, these points are written internally to arbitration logic. This defines the interaction with hardwired points, editable software configuration points and the relinquish default value/state. Refer to the Appendix for additional information.
Input	Points with the Input suffix are defined as read-only. These points normally reflect the status of a sensor input, either hardwired or communicating wirelessly (Air-Fi). However, the input point reflects the arbitrated result of the controller sensor input and a communicated value, if present. When both a controller sensor and communicated value exist, the controller will use and report the communicated value.
Arbitrator	Points with the "Arbitrator" suffix are to be used as read-only. The arbitrator prioritizes inputs from communicating points, hardwired points and stored defaults points. The priority array of the arbitration point displays each of the values provided, including the active status, indicating which of the input sources is being used. Refer to the Appendix for additional information.
BAS	Points with the BAS suffix are defined as read/write. These points are provided for use by the building automation system (BAS). When used, these points are written to arbitration logic. This defines the interaction with hardwired points, editable software configuration points and the relinquished default value/state. Refer to the Appendix for additional information.
Command	Points with the Command suffix are defined as read/write. These points are written to change the default behavior of the controller. Once written, these point values may be persisted.
Request	Points with the Request suffix are defined as read/write. These points are written to request a change the operating behavior of the controller.

## Object Data Points and Diagnostic Data Points

The following tables are sorted as follows:

- Tables are listed by input/output type and sorted by object identifier. These tables provide the user with the units type for each object type.
- Tables are sorted by object name and provide a complete list of object names, types, values/ranges, and descriptions.



## Points List

**Note:** Not all points are available to the user. The available data points are defined during self-configuration and are dependent on the type of equipment.

**Table 1. Analog input**

Object Identifier	Object Name	Description	Units	VVDA <sup>(a)</sup>	CVDA <sup>(b)</sup>	VVZT <sup>(c)</sup>	CVZT <sup>(d)</sup>	When Exists
AI-10101	Cooling Capacity Status	Indicates the actual operating unit cooling capacity	Percent	X	X	X	X	All Packaged RTU
AI-10102	Heating Capacity Primary Status	Indicates the unit (primary) heating capacity	Percent	X	X	X	X	Heat Present
AI-10104	Outdoor Air Relative Humidity Local	Indicates the outdoor air humidity value from sensor connected to the controller	Percent	X	X	X	X	Economizer with Reference or Comparative Enthalpy
AI-10105	Outdoor Air Flow Local	Indicates the measured outdoor air flow intake to the unit as reported by the locally-wired air flow monitoring feature	Cubic Feet Per Minute	X	X	X	X	TRAQ Present
AI-10107	Space Static Pressure Local	Indicates the space static pressure from a sensor connected to the controller	Inches of Water	X	X	X	X	Space Pressure Management Present
AI-10110	Return Air Humidity Local	Indicates the return air humidity value from sensor connected to the controller	Percent	X	X	X	X	Economizer with Reference or Comparative Enthalpy
AI-10111	Outdoor Air Damper Position	Indicates the position of the outside air damper as requested by the controller. This value does not reflect position feedback from the damper actuator.	Percent	X	X	X	X	Economizer Present
AI-10112	Exhaust Damper Position	Indicates the unit exhaust damper position	Percent	X	X	X	X	Barometric or Powered Relief
AI-10114	Outdoor Air Minimum Flow Setpoint Active	Indicates the active minimum outdoor air flow setpoint being used by the controller	Cubic Feet Per Minute	X	X	X	X	TRAQ Present
AI-10116	Space Humidity Active	Indicates the active space relative humidity being used by the controller	Percent	X	X	X	X	Hot Gas Reheat Present
AI-10117	Outdoor Air Dew Point	Indicates the outdoor air dew point value calculated from sensors connected to the controller or BAS values	Degrees Fahrenheit	X	X	X	X	Hot Gas Reheat Present
AI-10118	Outdoor Air Temperature Active	Indicates the active outdoor air temperature currently being used by the controller	Degrees Fahrenheit	X	X	X	X	All Packaged RTU
AI-10120	Outdoor Air Humidity Active	Indicates the active outdoor air humidity value used by the controller, considering all potential sources, local to the controller and remote	Percent	X	X	X	X	Economizer with Reference or Comparative Enthalpy
AI-10121	Discharge Air Cooling Setpoint Active	Indicates the discharge air temperature cooling setpoint value resulting from any setpoint arbitration. The active value does NOT reflect any modifications that may be in place as part of setpoint reset. For the actual value being used, refer to the "...status"	Degrees Fahrenheit	X	X	X	X	All Packaged RTU
AI-10122	Discharge Air Heating Setpoint Active	Indicates the discharge air temperature heating setpoint value resulting from any setpoint arbitration. The active value does NOT reflect any modifications that may be in place as part of setpoint reset. For the actual value being used, refer to the "...status"	Degrees Fahrenheit	X	X	X	X	Heat Present
AI-10123	Duct Static Pressure Setpoint Active	Indicates the duct static pressure control setpoint value resulting from any setpoint arbitration	Inches of Water	X				Multiple-zone VAV Units

**Table 1. Analog input (continued)**

Object Identifier	Object Name	Description	Units	VVDA <sup>(a)</sup>	CVDA <sup>(b)</sup>	VVZT <sup>(c)</sup>	CVZT <sup>(d)</sup>	When Exists
AI-10124	Discharge Air Temperature	Indicates the actual discharge air temperature being used by the controller	Degrees Fahrenheit	X	X	X	X	All Packaged RTU
AI-10125	Mixed Air Temperature Local	Indicates the mixed air temperature value from a sensor physically connected to the controller	Degrees Fahrenheit	X	X	X	X	All Packaged RTU
AI-10126	Return Air Temperature	Indicates the actual return air temperature being used by the controller	Degrees Fahrenheit	X	X	X	X	Economizer with Reference or Comparative Enthalpy or Rapid Restart
AI-10128	Space Static Pressure Setpoint Active	Indicates the active space static pressure being used by the controller	Inches of Water	X	X	X	X	Space Pressure Management Present
AI-10135	Space Dehumidification Setpoint Active	Indicates the active (occupied) space dehumidification setpoint, considering all potential sources	Percent	X	X	X	X	Hot Gas Reheat Present
AI-10152	Exhaust Fan Speed Status	Indicates the commanded speed of the modulating exhaust fan	Percent	X	X	X	X	Relief/Exhaust Fan Present
AI-10153	Return Fan Speed Status	Indicates the unit commanded return fan speed	Percent	X	X	X	X	Return Fan Present
AI-10154	Economizer Minimum Position Setpoint Active	Indicates the economizer minimum position setpoint value resulting from any setpoint arbitration	Percent	X	X	X	X	Economizer Present
AI-10155	Duct Static Pressure Local	Indicates the duct static pressure value from a sensor physically connected to the controller	Inches of Water	X	X	X	X	All Packaged RTU
AI-10156	Outdoor Air Temperature Local	Indicates the outdoor air temperature value from a sensor physically connected to the controller	Degrees Fahrenheit	X	X	X	X	All Packaged RTU
AI-10157	Dehumidification Control Status	Indicates the status of the unit dehumidification capacity	Percent	X	X	X	X	Hot Gas Reheat Present
AI-10161	Condenser Capacity	Indicates the status of the unit condenser capacity, in percent	Percent	X	X	X	X	All Packaged RTU
AI-10166	Energy Recovery Leaving Exhaust Temperature Status	Energy recovery leaving exhaust temperature	Degrees Fahrenheit	X		X		Energy Recovery Wheel
AI-10167	Energy Recovery Outdoor Air Bypass Damper Status	Energy recovery outdoor air bypass damper position	Percent	X		X		Energy Recovery Wheel
AI-10168	Energy Recovery Exhaust Air Bypass Damper Position	Energy recovery exhaust air bypass damper position	Percent	X		X		Energy Recovery Wheel
AI-10172	Reheat Capacity Status	Indicates the unit reheat capacity being requested by the controller, in percent	Percent	X	X	X	X	Hot Gas Reheat Present
AI-10173	Supply Fan Speed Status	Indicates the commanded speed of the supply fan, in percent	Percent	X		X		All Packaged RTU
AI-10181	Discharge Air Temperature Local	Indicates the discharge air temperature value from a sensor physically connected to the controller	Degrees Fahrenheit	X	X	X	X	All Packaged RTU
AI-10185	Outdoor Air Flow Active	Indicates the active outdoor air flow being used by the controller	Cubic Feet Per Minute	X	X	X	X	TRAQ Present
AI-10186	Space Temperature Active	Indicates the active space temperature being used by the controller	Degrees Fahrenheit	X	X	X	X	All Packaged RTU
AI-10188	Space CO2 Concentration Active	Indicates the active space CO2 concentration being used by the controller	Parts Per Million	X	X	X	X	TRAQ or Demand Control Ventilation
AI-10190	Space Temperature Cooling Setpoint Input	Indicates the (occupied) cooling temperature setpoint from the connected space sensor	Degrees Fahrenheit			X	X	Zone Temperature Control Units



## Points List

**Table 1. Analog input (continued)**

Object Identifier	Object Name	Description	Units	VVDA <sup>(a)</sup>	CVDA <sup>(b)</sup>	VVZT <sup>(c)</sup>	CVZT <sup>(d)</sup>	When Exists
AI-10191	Space Temperature Heating Setpoint Input	Indicates the (occupied) heating temperature setpoint from the connected space sensor	Degrees Fahrenheit			X	X	Heat Present and Zone Temperature Control Units
AI-10197	Heat Type	Identifies the product heat type	No Units	X	X	X	X	All Packaged RTU
AI-10198	Cabinet Style	Indicates the cabinet style of the unit	No Units	X	X	X	X	All Packaged RTU
AI-10199	Cool Type	Indicates the type of cooling in the unit	No Units	X	X	X	X	All Packaged RTU
AI-10200	Preheat Type	Indicates the type of preheat in the unit	No Units	X	X	X	X	All Packaged RTU
AI-10201	Reheat Type	Indicates the type of reheat in the unit	No Units	X	X	X	X	All Packaged RTU
AI-10202	Supply Fan Type	Indicates the type of supply fan in the unit	No Units	X	X	X	X	All Packaged RTU
AI-10203	Exhaust Or Return Fan Type	Indicates the type of exhaust fan or return fan in the unit	No Units	X	X	X	X	All Packaged RTU
AI-10204	Exhaust Fan Speed Setpoint Active	Active setpoint input to exhaust/ relief fan control	Percent	X	X	X	X	Relief/Exhaust Fan Present
AI-10206	Number of Circuits	Indicates the number of refrigeration circuits in the unit	No Units	X	X	X	X	All Packaged RTU
AI-10207	Number of Compressors Circuit 1	Indicates the number of compressors on DX circuit 1 of the unit	No Units	X	X	X	X	All Packaged RTU
AI-10208	Number of Compressors Circuit 2	Indicates the number of compressors on DX circuit 2 of the unit	No Units	X	X	X	X	All Packaged RTU, 40-75T
AI-10210	Return Isolation Damper Input	Indicates the requested position of the return isolation damper	Percent	X	X	X	X	Supply or Supply/ Return Dampers Present
AI-10213	Space CO2 Concentration Input	Indicates the space CO2 concentration from a sensor connected to the controller	Parts Per Million	X	X	X	X	TRAQ or Demand Control Ventilation
AI-10214	Space Dehumidification Unoccupied Setpoint Active	Indicates the active unoccupied space dehumidification setpoint, considering all potential sources	Percent	X	X	X	X	Hot Gas Reheat Present
AI-10215	Space Humidity Input	Indicates the space relative humidity from a sensor connected to the controller	Percent	X	X	X	X	Hot Gas Reheat Present
AI-10216	Space Temp Cooling Setpoint Status	Indicates the (occupied) cooling temperature setpoint from the connected space sensor module	Degrees Fahrenheit			X	X	Zone Temperature Control Units
AI-10217	Space Temp Heating Setpoint Status	Indicates the (occupied) heating temperature setpoint from the connected space sensor module	Degrees Fahrenheit			X	X	Heat Present and Zone Temperature Control Units
AI-10218	Space Temperature Input	Indicates the space temperature from a sensor connected to the controller, either wired or wireless	Degrees Fahrenheit	X	X	X	X	All Packaged RTU
AI-10221	Space Temperature Setpoint Active	Indicates the active space temperature setpoint being used by the controller	Degrees Fahrenheit			X	X	Zone Temperature Control Units
AI-10222	Supply Isolation Damper Input	Indicates the requested position of the supply isolation damper, when present	Percent	X	X	X	X	Supply or Supply/ Return Dampers Present
AI-10224	Average Current	Indicates the average current, as reported by the optional power monitoring feature of the product	Amps	X	X	X	X	Power Monitoring Present
AI-10227	Run Time - Compressor 1A	Indicates the run time of Compressor 1A	No Units	X	X	X	X	All Packaged RTU
AI-10228	Starts - Compressor 1A	Indicates the number of starts for Compressor 1A	No Units	X	X	X	X	All Packaged RTU
AI-10229	Run Time - Compressor 1B	Indicates the run time of Compressor 1B	No Units	X	X	X	X	All Packaged RTU, 20-75T
AI-10230	Starts - Compressor 1B	Indicates the number of starts for Compressor 1B	No Units	X	X	X	X	All Packaged RTU, 20-75T
AI-10231	Run Time - Compressor 1C	Indicates the run time of Compressor 1C	No Units	X	X	X	X	All Packaged RTU, 20-30T
AI-10232	Starts - Compressor 1C	Indicates the number of starts for Compressor 1C	No Units	X	X	X	X	All Packaged RTU, 20-30T

**Table 1. Analog input (continued)**

Object Identifier	Object Name	Description	Units	VVDA <sup>(a)</sup>	CVDA <sup>(b)</sup>	VVZT <sup>(c)</sup>	CVZT <sup>(d)</sup>	When Exists
AI-10233	Run Time - Compressor 2A	Indicates the run time of Compressor 2A	No Units	X	X	X	X	All Packaged RTU, 40-75T
AI-10234	Starts - Compressor 2A	Indicates the number of starts for Compressor 2A	No Units	X	X	X	X	All Packaged RTU, 40-75T
AI-10235	Run Time - Compressor 2B	Indicates the run time of Compressor 2B	No Units	X	X	X	X	All Packaged RTU, 40-75T
AI-10236	Starts - Compressor 2B	Indicates the number of starts for Compressor 2B	No Units	X	X	X	X	All Packaged RTU, 40-75T
AI-10237	Run Time - Compressor 2C	Run Time - Compressor 2C	No Units	X	X	X	X	All Packaged RTU, 40-75T
AI-10238	Starts - Compressor 2C	Starts - Compressor 2C	No Units	X	X	X	X	All Packaged RTU, 40-75T
AI-10239	Current L1	Indicates the current for line/leg 1, as reported by the optional power monitoring feature of the product	Amps	X	X	X	X	Power Monitoring Present
AI-10240	Current L2	Indicates the current for line/leg 2, as reported by the optional power monitoring feature of the product	Amps	X	X	X	X	Power Monitoring Present
AI-10241	Current L3	Indicates the current for line/leg 3, as reported by the optional power monitoring feature of the product	Amps	X	X	X	X	Power Monitoring Present
AI-10242	Current Neutral	Indicates the current for neutral, as reported by the optional power monitoring feature of the product	Amps	X	X	X	X	Power Monitoring Present
AI-10243	Discharge Air Cooling Setpoint Status	Indicates the actual discharge air temperature cooling setpoint value, including all setpoint arbitration and any reset algorithms	Degrees Fahrenheit	X	X			Discharge Air Temperature Control
AI-10244	Discharge Air Heating Setpoint Status	Indicates the actual discharge air temperature heating setpoint value, including all setpoint arbitration and any reset algorithms	Degrees Fahrenheit	X	X			Heat Present and Discharge Air Temperature Control
AI-10246	Discharge Pressure Circuit 1	Indicates the refrigerant discharge pressure for DX circuit 1, in PSIG	Pounds Per Square Inch	X	X	X	X	All Packaged RTU
AI-10247	Discharge Pressure Circuit 2	Indicates the refrigerant discharge pressure for DX circuit 2, in PSIG	Pounds Per Square Inch	X	X	X	X	All Packaged RTU, 40-75T
AI-10249	Energy Consumption Lifetime	Indicates the total energy consumption of the unit (for the lifetime of the unit) when the power monitoring feature is included	kWh	X	X	X	X	Power Monitoring Present
AI-10250	Evaporator Leaving Air Temperature	Indicates the leaving air temperature of the evaporator	Degrees Fahrenheit	X	X	X	X	Hot Gas Reheat Present
AI-10251	Evaporator Leaving Air Temperature Evap A	Indicates the leaving air temperature of evaporator A when a split evaporator is used	Degrees Fahrenheit	X	X	X	X	Hot Gas Reheat Present
AI-10252	Evaporator Leaving Air Temperature Evap B	Indicates the leaving air temperature of evaporator B when a split evaporator is used	Degrees Fahrenheit	X	X	X	X	Hot Gas Reheat Present
AI-10253	Evaporator Leaving Air Temperature Setpoint Active	Indicates the evaporator leaving air temperature setpoint value resulting from any setpoint arbitration, when applicable	Degrees Fahrenheit	X	X			Hot Gas Reheat Present
AI-10254	Final Filter Differential Pressure Local	Indicates the status of the final filter differential pressure sensor input on the controller	Inches of Water	X	X	X	X	Final Filters Present
AI-10255	Line Frequency	Indicates the line frequency when the optional power monitoring option is included	No Units	X	X	X	X	Power Monitoring Present
AI-10256	Mixed Air Temperature Evap A	Indicates the mixed air temperature associated with evaporator A when a split evaporator is used	Degrees Fahrenheit	X	X	X	X	High-efficiency or Variable Speed Refrigeration System, 70-75T



## Points List

**Table 1. Analog input (continued)**

Object Identifier	Object Name	Description	Units	VVDA <sup>(a)</sup>	CVDA <sup>(b)</sup>	VVZT <sup>(c)</sup>	CVZT <sup>(d)</sup>	When Exists
AI-10257	Mixed Air Temperature Evap B	Indicates the mixed air temperature associated with evaporator B when a split evaporator is used	Degrees Fahrenheit	X	X	X	X	High-efficiency or Variable Speed Refrigeration System, 70-75T
AI-10258	Power Factor	Indicates the reported power factor from the optional power monitoring option, when applicable	No Units	X	X	X	X	Power Monitoring Present
AI-10259	Prefilter Differential Pressure Local	Indicates the status of the pre-final filter differential pressure sensor input on the controller	Inches of Water	X	X	X	X	Pre-filters Present
AI-10262	Suction Pressure Circuit 1	Indicates the suction pressure for DX circuit 1, in PSIG	Pounds Per Square Inch	X	X	X	X	All Packaged RTU
AI-10263	Suction Pressure Circuit 2	Indicates the suction pressure for DX circuit 2, in PSIG	Pounds Per Square Inch	X	X	X	X	All Packaged RTU, 40-75T
AI-10268	Total Apparent Energy	Indicates the total apparent energy as reported by the optional power monitoring feature, when present	kWh	X	X	X	X	Power Monitoring Present
AI-10269	Energy Consumption	Indicates the total energy consumption of the unit (since last accumulation reset) when the power monitoring feature is included	kWh	X	X	X	X	Power Monitoring Present
AI-10270	Total Reactive Energy	Indicates the total reactive energy as reported by the optional power monitoring feature, when present	kWh	X	X	X	X	Power Monitoring Present
AI-10271	Total Real Power	Indicates the total real power as reported by the optional power monitoring feature, when present	kW	X	X	X	X	Power Monitoring Present
AI-10272	Total Apparent Power	Indicates the total apparent power as reported by the optional power monitoring feature, when present	kW	X	X	X	X	Power Monitoring Present
AI-10273	Total Reactive Power	Indicates the total reactive power as reported by the optional power monitoring feature, when present	kW	X	X	X	X	Power Monitoring Present
AI-10274	Unit Source ID	Indicates the last diagnostic of the unit Separately, individual diagnostics are reported with dedicated points, variables, registers	No Units	X	X	X	X	All Packaged RTU
AI-10275	Voltage L1-L2	Indicates the voltage between line/leg L1 and L2	Volts	X	X	X	X	Power Monitoring Present
AI-10276	Voltage L1-L3	Indicates the voltage between line/leg L1 and L3	Volts	X	X	X	X	Power Monitoring Present
AI-10277	Voltage L1-N	Indicates the voltage between line/leg L1 and Neutral	Volts	X	X	X	X	Power Monitoring Present
AI-10278	Voltage L2-L3	Indicates the voltage between line/leg L2 and L3	Volts	X	X	X	X	Power Monitoring Present
AI-10279	Voltage L2-N	Indicates the voltage between line/leg L2 and Neutral	Volts	X	X	X	X	Power Monitoring Present
AI-10280	Voltage L3-N	Indicates the voltage between line/leg L3 and Neutral	Volts	X	X	X	X	Power Monitoring Present
AI-10281	Discharge Air Temperature Setpoint Active	Indicates the discharge air temperature setpoint value resulting from any setpoint arbitration	Degrees Fahrenheit	X	X	X	X	All Packaged RTU
AI-10282	Air Flow Percentage Circuit 1	Indicates the requested condenser percentage for circuit 1	Percent	X	X	X	X	All Packaged RTU
AI-10283	Air Flow Percentage Circuit 2	Indicates the requested condenser percentage for circuit 2	Percent	X	X	X	X	All Packaged RTU, 40-75T
AI-10284	Discharge Saturated Refrigeration Temperature Circuit 1	Indicates the discharge saturated refrigerant temperature for DX circuit 2	Degrees Fahrenheit	X	X	X	X	All Packaged RTU

**Table 1. Analog input (continued)**

Object Identifier	Object Name	Description	Units	VVDA <sup>(a)</sup>	CVDA <sup>(b)</sup>	VVZT <sup>(c)</sup>	CVZT <sup>(d)</sup>	When Exists
AI-10285	Discharge Saturated Refrigeration Temperature Circuit 2	Indicates the discharge saturated refrigerant temperature for DX circuit 2	Degrees Fahrenheit	X	X	X	X	All Packaged RTU, 40-75T
AI-10286	Suction Saturated Refrigerant Temperature Circuit 1	Indicates suction saturated refrigerant temperature for DX circuit 1	Degrees Fahrenheit	X	X	X	X	All Packaged RTU
AI-10287	Suction Saturated Refrigerant Temperature Circuit 2	Indicates suction saturated refrigerant temperature for DX circuit 2	Degrees Fahrenheit	X	X	X	X	All Packaged RTU, 40-75T
AI-10288	Suction Temperature Evap 1A	Indicates the suction temperature for evaporator 1A	Degrees Fahrenheit	X	X	X	X	High-efficiency or Variable Speed Refrigeration System, 70-75T
AI-10289	Suction Temperature Evap 1B	Indicates the suction temperature for evaporator 1B	Degrees Fahrenheit	X	X	X	X	High-efficiency or Variable Speed Refrigeration System, 70-75T
AI-10290	Suction Temperature Evap 2A	Indicates the suction temperature for evaporator 2A	Degrees Fahrenheit	X	X	X	X	High-efficiency or Variable Speed Refrigeration System, 70-75T
AI-10291	Suction Temperature Evap 2B	Indicates the suction temperature for evaporator 2B	Degrees Fahrenheit	X	X	X	X	High-efficiency or Variable Speed Refrigeration System, 70-75T
AI-10292	Occupied Cooling Setpoint	Indicates the active occupied cooling setpoint being used by the controller, considering all possible sources	Degrees Fahrenheit			X	X	Zone Temperature Control Units
AI-10293	Occupied Heating Setpoint	Indicates the active occupied heating setpoint being used by the controller, considering all possible sources	Degrees Fahrenheit			X	X	Heat Present and Zone Temperature Control
AI-10294	Occupied Standby Cooling Setpoint	Indicates the active occupied standby cooling setpoint being used by the controller, considering all possible sources	Degrees Fahrenheit			X	X	Zone Temperature Control Units
AI-10295	Occupied Standby Heating Setpoint	Indicates the active occupied standby heating setpoint being used by the controller, considering all possible sources	Degrees Fahrenheit			X	X	Heat Present and Zone Temperature Control
AI-10296	Supply Fan Speed Setpoint Active	Active setpoint input to supply fan control	Percent	X		X		Variable Volume Supply Fan Present
AI-10297	Discharge Air Temperature Maximum Cool Limit Active	Indicates maximum cooling setpoint allowed to be calculated by Space Temp Control	Degrees Fahrenheit			X	X	Zone Temperature Control Units
AI-10298	Discharge Air Temperature Minimum Heat Limit Active	Indicates minimum heating setpoint allowed to be calculated by Space Temp Control	Degrees Fahrenheit			X	X	Heat Present and Zone Temperature Control
AI-10299	Discharge Air Temperature Minimum Cool Limit Active	Indicates minimum cooling setpoint allowed to be calculated by Space Temp Control	Degrees Fahrenheit			X	X	Zone Temperature Control Units
AI-10300	Discharge Air Temperature Maximum Heat Limit Active	Indicates minimum heating setpoint allowed to be calculated by Space Temp Control	Degrees Fahrenheit			X	X	Heat Present and Zone Temperature Control
AI-10301	Energy Recovery Heating Capacity	Indicates percentage heating capacity of all bypass damper operation during heating.	Percent	X		X		Energy Recovery Wheel
AI-10302	Energy Recovery Cooling Capacity	Indicates percentage cooling capacity of all bypass damper operation during cooling.	Percent	X		X		Energy Recovery Wheel
AI-10303	Energy Recovery Wheel Filter Differential Pressure	Indicates differential pressure across the energy wheel filter	Inches of Water	X		X		Energy Recovery Wheel



## Points List

**Table 1. Analog input (continued)**

Object Identifier	Object Name	Description	Units	VVDA <sup>(a)</sup>	CVDA <sup>(b)</sup>	VVZT <sup>(c)</sup>	CVZT <sup>(d)</sup>	When Exists
AI-10304	Average Current Meter 2	Indicates the average current for the second power meter (air handling section), as reported by the optional power monitoring feature of the product	Amps	X	X	X	X	Dual Power Monitoring Present
AI-10305	Current L1 Meter 2	Indicates the current for line/leg 1 for the second power meter (air handling section), as reported by the optional power monitoring feature of the product	Amps	X	X	X	X	Dual Power Monitoring Present
AI-10306	Current L2 Meter 2	Indicates the current for line/leg 2 for the second power meter (air handling section), as reported by the optional power monitoring feature of the product	Amps	X	X	X	X	Dual Power Monitoring Present
AI-10307	Current L3 Meter 2	Indicates the current for line/leg 3 for the second power meter (air handling section), as reported by the optional power monitoring feature of the product	Amps	X	X	X	X	Dual Power Monitoring Present
AI-10308	Current Neutral Meter 2	Indicates the current for neutral for the second power meter (air handling section), as reported by the optional power monitoring feature of the product	Amps	X	X	X	X	Dual Power Monitoring Present
AI-10309	Energy Consumption Meter 2	Indicates the energy consumption (since last reset) for the second power meter (air handling section), as reported by the optional power monitoring feature of the product	kWh	X	X	X	X	Dual Power Monitoring Present
AI-10310	Energy Consumption Lifetime Meter 2	Indicates the energy consumption for the second power meter (air handling section), as reported by the optional power monitoring feature of the product	kWh	X	X	X	X	Dual Power Monitoring Present
AI-10311	Line Frequency Meter 2	Indicates the line frequency for the second power meter (air handling section), as reported by the optional power monitoring feature of the product	No Units	X	X	X	X	Dual Power Monitoring Present
AI-10312	Power Factor Meter 2	Indicates the power factor for the second power meter (air handling section), as reported by the optional power monitoring feature of the product	No Units	X	X	X	X	Dual Power Monitoring Present
AI-10313	Total Apparent Energy Meter 2	Indicates the total apparent energy for the second power meter (air handling section), as reported by the optional power monitoring feature of the product	kWh	X	X	X	X	Dual Power Monitoring Present
AI-10314	Total Apparent Power Meter 2	Indicates the total apparent power for the second power meter (air handling section), as reported by the optional power monitoring feature of the product	kW	X	X	X	X	Dual Power Monitoring Present
AI-10315	Total Reactive Energy Meter 2	Indicates the total reactive energy for the second power meter (air handling section), as reported by the optional power monitoring feature of the product	kWh	X	X	X	X	Dual Power Monitoring Present
AI-10316	Total Reactive Power Meter 2	Indicates the total reactive power for the second power meter (air handling section), as reported by the optional power monitoring feature of the product	kW	X	X	X	X	Dual Power Monitoring Present



Points List

**Table 1. Analog input (continued)**

Object Identifier	Object Name	Description	Units	VVDA <sup>(a)</sup>	CVDA <sup>(b)</sup>	VVZT <sup>(c)</sup>	CVZT <sup>(d)</sup>	When Exists
AI-10317	Total Real Power Meter 2	Indicates the total real power for the second power meter (air handling section), as reported by the optional power monitoring feature of the product	kW	X	X	X	X	Dual Power Monitoring Present
AI-10318	Voltage L1-L2 Meter 2	Indicates the voltage between line/leg L1 and L2 for the second power meter (air handling section), as reported by the optional power monitoring feature of the product	Volts	X	X	X	X	Dual Power Monitoring Present
AI-10319	Voltage L1-L3 Meter 2	Indicates the voltage between line/leg L1 and L3 for the second power meter (air handling section), as reported by the optional power monitoring feature of the product	Volts	X	X	X	X	Dual Power Monitoring Present
AI-10320	Voltage L1-N Meter 2	Indicates the voltage between line/leg L1 and Neutral for the second power meter (air handling section), as reported by the optional power monitoring feature of the product	Volts	X	X	X	X	Dual Power Monitoring Present
AI-10321	Voltage L2-L3 Meter 2	Indicates the voltage between line/leg L2 and L3 for the second power meter (air handling section), as reported by the optional power monitoring feature of the product	Volts	X	X	X	X	Dual Power Monitoring Present
AI-10322	Voltage L2-N Meter 2	Indicates the voltage between line/leg L2 and Neutral for the second power meter (air handling section), as reported by the optional power monitoring feature of the product	Volts	X	X	X	X	Dual Power Monitoring Present
AI-10323	Voltage L3-N Meter 2	Indicates the voltage between line/leg L3 and Neutral for the second power meter (air handling section), as reported by the optional power monitoring feature of the product	Volts	X	X	X	X	Dual Power Monitoring Present
AI-10324	Run Time - Compressor 1A (Hours)	Indicates the run time of Compressor 1A, in hours	No Units	X	X	X	X	All Packaged RTU
AI-10325	Run Time - Compressor 1B (Hours)	Indicates the run time of Compressor 1B, in hours	No Units	X	X	X	X	All Packaged RTU, 20-75T
AI-10326	Run Time - Compressor 1C (Hours)	Indicates the run time of Compressor 1C, in hours	No Units	X	X	X	X	All Packaged RTU, 20-30T
AI-10327	Run Time - Compressor 2A (Hours)	Indicates the run time of Compressor 2A, in hours	No Units	X	X	X	X	All Packaged RTU, 40-75T
AI-10328	Run Time - Compressor 2B (Hours)	Indicates the run time of Compressor 2B, in hours	No Units	X	X	X	X	All Packaged RTU, 40-75T
AI-10329	Run Time - Compressor 2C (Hours)	Indicates the run time of Compressor 2C, in hours	No Units	X	X	X	X	All Packaged RTU, 40-75T
AI-10330	Discharge Absolute Pressure Circuit 1	Indicates the refrigerant discharge pressure for DX circuit 1, in PSIA	Pounds Per Square Inch	X	X	X	X	All Packaged RTU
AI-10331	Discharge Absolute Pressure Circuit 2	Indicates the refrigerant discharge pressure for DX circuit 2, in PSIA	Pounds Per Square Inch	X	X	X	X	All Packaged RTU, 40-75T
AI-10332	Suction Absolute Pressure Circuit 1	Indicates the suction pressure for DX circuit 1, in PSIA	Pounds Per Square Inch	X	X	X	X	All Packaged RTU
AI-10333	Suction Absolute Pressure Circuit 2	Indicates the suction pressure for DX circuit 2, in PSIA	Pounds Per Square Inch	X	X	X	X	All Packaged RTU, 40-75T
AI-10334	Space Dew Point	Indicates the calculated space dew point from space humid active,space temp active	Degrees Fahrenheit	X	X	X	X	Energy Recovery Wheel



## Points List

**Table 1. Analog input (continued)**

Object Identifier	Object Name	Description	Units	VVDA <sup>(a)</sup>	CVDA <sup>(b)</sup>	VVZT <sup>(c)</sup>	CVZT <sup>(d)</sup>	When Exists
AI-10335	Space Dew Point Setpoint Active	Active occupied space dew point setpoint	Degrees Fahrenheit	X	X	X	X	Energy Recovery Wheel
AI-10336	Space Dew Point Unocc Setpoint Active	Active unoccupied space dew point setpoint	Degrees Fahrenheit	X	X	X	X	Energy Recovery Wheel
AI-10337	Heating Capacity Setpoint Active	Status of current heating capacity request	Percent	X	X	X	X	Energy Recovery Wheel
AI-10338	Outdoor Air Damper Position Setpoint Active	Status of current outdoor air damper position request	Percent	X	X	X	X	Economizer Present
AI-10339	Return Fan Speed Setpoint Active	Status of current return fan speed request	Percent	X	X	X	X	Return Fan Present
AI-10340	Cooling Capacity Setpoint Active	Status of current cooling capacity request	Percent	X	X	X	X	All Packaged RTU

(a) VVDA - Variable Volume Discharge Air Temperature Control

(b) CVDA - Constant Volume Discharge Air Temperature Control

(c) VVZT - Variable Volume Zone Temperature Control

(d) CVZT - Constant Volume Zone Temperature Control

**Table 2. Analog value**

Object Identifier	Object Name	Description	Units	Valid Range	VWDA <sup>(a)</sup>	CVDA <sup>(b)</sup>	VWZT <sup>(c)</sup>	CVZT <sup>(c)</sup>	When Exists	Last One Wins <sup>(e)</sup>	Heartbeat <sup>(f)</sup>
AV-10101	Discharge Air Temperature Arbitrator	Indicates the actual discharge air temperature being used by the controller, as determined by the arbitration logic that considers all possible sources	Degrees Fahrenheit	-40.0 to 200.0°F	X						
AV-10103	Outdoor Air Temperature Arbitrator	Indicates the actual outdoor air temperature being used by the controller, as determined by the arbitration logic that considers all possible sources	Degrees Fahrenheit	-40.0 to 200.0°F	X	X	X		X	Economizer Present	
AV-10104	Outdoor Air Humidity Arbitrator	Indicates the actual outdoor air humidity being used by the controller, as determined by the arbitration logic that considers all possible sources	Percent	0.0 to 100.0 %		X	X		X	Economizer with Reference or Comparative Enthalpy	
AV-10105	Outdoor Air Flow Arbitrator	Indicates the actual outdoor air flow being used by the controller, as determined by the arbitration logic that considers all possible sources	Cubic Feet per Minute	0 to 65,535 CFM		X	X		X	TRAQ Present	
AV-10106	Space Temperature Arbitrator	Indicates the actual space temperature being used by the controller, as determined by the arbitration logic that considers all possible sources	Degrees Fahrenheit	-40.0 to 200.0°F		X	X		X	All Packaged RTU	
AV-10108	Space CO2 Concentration Arbitrator	Indicates the actual space CO2 concentration being used by the controller, as determined by the arbitration logic that considers all possible sources	Parts Per Million	0 to 65,535 PPM		X	X		X	Economizer with TRAQ or Demand Control Ventilation	

**Table 2. Analog value (continued)**

Object Identifier	Object Name	Description	Units	Valid Range	WVDA <sup>(a)</sup>	CVDA <sup>(b)</sup>	WZT <sup>(c)</sup>	CVZT <sup>(c)</sup>	When Exists	Last One Wins <sup>(e)</sup>	Heartbeat <sup>(f)</sup>
AV-10109	Space Humidity Arbitrator	Indicates the actual space relative humidity being used by the controller, as determined by the arbitration logic that considers all possible sources	Percent	0.0 to 100.0 %	X	X	X	X			
AV-10111	Discharge Air Temperature BAS	The value is normally provided by the BAS to send the discharge air temperature sensor value. The value is subject to arbitration logic in the controller, in which case it may or may not be used for control purposes.	Degrees Fahrenheit	-40.0 to 200.0°F	X	X			Discharge Air Temperature Control	X	▼
AV-10113	Outdoor Air Temperature BAS	The value is normally provided by the BAS to send the outdoor air temperature sensor value. The value is subject to arbitration logic in the controller, in which case it may or may not be used for control purposes.	Degrees Fahrenheit	-40.0 to 200.0°F	X	X	X	X	Economizer Present	X	▼
AV-10114	Space Temperature BAS	The value is normally provided by the BAS to send the space temperature value. The value is subject to arbitration logic in the controller, in which case it may or may not be used for control purposes.	Degrees Fahrenheit	14.0 to 122.0°F	X	X	X	X	All Packaged RTU	X	▼
AV-10115	Outdoor Air Flow BAS	The value is normally provided by the BAS to send the outdoor air flow value. The value is subject to arbitration logic in the controller, in which case it may or may not be used for control purposes.	Cubic Feet per Minute	0 to 65,000 CFM	X	X	X	X	TRAQ Present	X	▼

**Table 2. Analog value (continued)**

Object Identifier	Object Name	Description	Units	Valid Range	WVDA <sup>(a)</sup>	CVDA <sup>(b)</sup>	WZT <sup>(c)</sup>	CVZT <sup>(d)</sup>	When Exists	Last One Wins <sup>(e)</sup>	Heartbeat <sup>(f)</sup>
AV-10116	Outdoor Air Humidity BAS	The value is normally provided by the BAS to send the outdoor air humidity sensor value. The value is subject to arbitration logic in the controller, in which case it may or may not be used for control purposes.	Percent	0 to 100%	X	X	X	X	Economizer with Reference or Comparative Enthalpy	X	▼
AV-10118	Space CO2 Concentration BAS	The value is normally provided by the BAS to send the space CO2 concentration value. The value is subject to arbitration logic in the controller, in which case it may or may not be used for control purposes.	Parts Per Million	50 to 5000 PPM	X	X	X	X	Economizer with TRAQ or Demand Control Ventilation	X	▼
AV-10119	Space Humidity BAS	The value is normally provided by the BAS to send the space relative humidity value. The value is subject to arbitration logic in the controller, in which case it may or may not be used for control purposes.	Percent	10.0 to 90.0%	X	X	X	X	Hot Gas Reheat Present	X	▼
AV-10121	Discharge Air Cooling Setpoint BAS	Normally provided by the BAS to request the discharge air temperature cooling setpoint value	Degrees Fahrenheit	40.0 to 90.0°F	X	X	X	X	All Packaged RTU		
AV-10122	Discharge Air Heating Setpoint BAS	Normally provided by the BAS to request the discharge air temperature heating setpoint value	Degrees Fahrenheit	40.0 to 180.0°F	X	X	X	X	Heat Present		
AV-10123	Unoccupied Cooling Setpoint	Normally used by the BAS to define the cooling temperature setpoint used for control in unoccupied mode	Degrees Fahrenheit	52.0 to 90.0°F	X	X	X	X	All Packaged RTU	X	



## Points List

**Table 2. Analog value (continued)**

Object Identifier	Object Name	Description	Units	Valid Range	VVDA <sup>(a)</sup>	CVDA <sup>(b)</sup>	VZT <sup>(c)</sup>	CVZT <sup>(d)</sup>	When Exists	Last One Wins <sup>(e)</sup>	Heartbeat <sup>(f)</sup>
AV-10124	Unoccupied Heating Setpoint	Normally used by the BAS to define the heating temperature setpoint used for control in unoccupied mode	Degrees Fahrenheit	52.0 to 90.0°F	X	X	X	X	Heat Present	X	
AV-10125	Outdoor Air Minimum Flow Setpoint BAS	Normally provided by the BAS to send the requested minimum outdoor air flow setpoint	Cubic Feet per Minute	0 to 60,000 CFM	X	X	X	X	TRAQ Present		
AV-10127	Space Temperature Setpoint BAS	BAS-supplied space temperature setpoint value	Degrees Fahrenheit	50.0 to 95.0°F		X	X	X	Zone Temperature Control Units		
AV-10128	Space Static Pressure Setpoint BAS	The value is normally provided by the BAS to send the space static pressure value. The value is subject to arbitration logic in the controller, in which case it may or may not be used for control purposes.	Inches of Water	-0.2 to 0.3 in. w.c.		X	X	X	Space Pressure Management Present		
AV-10130	Occupied Offset	This value is normally provided by the BAS to define the difference between the occupied cooling and heating setpoints when a single setpoint is provided (see Space Temperature Setpoint BAS, below).	Delta Degrees Fahrenheit	0.0 to 30.0°F			X	X	Zone Temperature Control Units	X	
AV-10134	Discharge Air Reheat Setpoint BAS	Normally provided by the BAS to request the discharge air temperature reheat setpoint value, for dehumidification control	Degrees Fahrenheit	60.0 to 80.0°F		X	X		Discharge Air Temperature Control		
AV-10135	Space Dehumidification Setpoint BAS	Normally used by the BAS to define the (occupied) space dehumidification setpoint	Percent	40.0 to 65.0 %	X	X	X	X	Hot Gas Reheat Present		
AV-10136	Supply Fan Speed Setpoint	BAS supplied supply fan speed setpoint value	Percent	0.0 to 100.0 %	X	X			Variable Volume Supply Fan Control		

**Table 2. Analog value (continued)**

Object Identifier	Object Name	Description	Units	Valid Range	VVDA <sup>(a)</sup>	CVDA <sup>(b)</sup>	VZT <sup>(c)</sup>	CVZT <sup>(d)</sup>	When Exists	Last One Wins <sup>(e)</sup>	Heartbeat <sup>(f)</sup>
AV-10137	Exhaust Fan Speed Setpoint	BAS supplied exhaust fan speed setpoint value	Percent	0.0 to 100.0 %	X	X	X	X	Relief/Exhaust Fan Present		
AV-10139	Cooling Capacity Enable	This percentage value is normally provided by the BAS to demand limit the cooling capacity.	Percent	0.0 to 100.0 %	X	X	X	X	All Packaged RTU		
AV-10140	Heat Primary Enable BAS	This percentage value is normally provided by the BAS to demand limit the heating capacity.	Percent	0.0 to 100.0 %	X	X	X	X	Heat Present		
AV-10141	Morning Warmup Setpoint BAS	Normally provided by the BMS, defines the space temperature below which morning warmup will be exercised, when enabled	Degrees Fahrenheit	50.0 to 90.0°F	X	X	X	X	Heat Present	X	
AV-10142	Occupied Standby Offset	This value is normally provided by the BMS to define the difference between the occupied standby cooling and heating setpoints when a single setpoint is provided (see Space Temperature Setpoint BAS, below).	Delta Degrees Fahrenheit	1.0 to 10.0°F					Zone Temperature Control Units	X	
AV-10143	Duct Static Pressure Setpoint BAS	Normally provided by the BAS to request the duct static pressure setpoint value	Inches of Water	0.7 to 4.3 in. w. c.	X				Multiple-zone VAV Units		
AV-10144	Economizer Minimum Position Setpoint BAS	Normally provided by the BAS to request the economizer minimum position setpoint	Percent	0.0 to 100.0 %	X	X	X	X	Economizer Present		
AV-10147	Cooling Setpoint High Limit	The value is normally used by the BAS to provide the occupied cooling setpoint high limit for space comfort control applications.	Degrees Fahrenheit	40.0 to 115.0 °F					Zone Temperature Control Units	X	



## Points List

**Table 2. Analog value (continued)**

Object Identifier	Object Name	Description	Units	Valid Range	VVDA <sup>(a)</sup>	CVDA <sup>(b)</sup>	VZT <sup>(c)</sup>	CVZT <sup>(d)</sup>	When Exists	Last One Wins <sup>(e)</sup>	Heartbeat <sup>(f)</sup>
AV-10148	Cooling Setpoint Low Limit	The value is normally used by the BAS to provide the occupied cooling setpoint low limit for space comfort control applications.	Degrees Fahrenheit	40.0 to 115.0 °F			X	X	Zone Temperature Control Units	X	
AV-10149	Daytime Warmup Setpoint BAS	Defines the space temp below which daytime warmup will be enabled	Degrees Fahrenheit	50.0 to 87.0 °F	X	X			Heat Present and Discharge Temperature Control	X	
AV-10150	Economizer Outdoor Air Enable Setpoint BAS	Related to the economizer enable decision, this value is normally provided by the BAS to determine the outdoor air temperature below which economizing is enabled.	Degrees Fahrenheit	50.0 to 140.0 °F	X	X	X	X	Economizer Present	X	
AV-10152	Heating Setpoint High Limit	The value is normally used by the BAS to provide the occupied heating setpoint high limit for space comfort control applications.	Degrees Fahrenheit	40.0 to 115.0 °F			X	X	Heat Present and Zone Temperature Control	X	
AV-10153	Heating Setpoint Low Limit	The value is normally used by the BAS to provide the occupied heating setpoint low limit for space comfort control applications.	Degrees Fahrenheit	43.0 to 100.0 °F			X	X	Heat Present and Zone Temperature Control	X	
AV-10156	Space Dehumidification Unoccupied Setpoint BAS	Normally used by the BAS to define the unoccupied space dehumidification setpoint	Percent	40.0 to 65.0 %	X	X	X	X	Hot Gas Reheat Present		
AV-10159	Occupied Cooling Setpoint BAS	The value is normally provided by the BAS to define the occupied cooling setpoint when both heating and cooling setpoints are provided in lieu of a single setpoint	Degrees Fahrenheit	40.0 to 115.0 °F			X	X	Zone Temperature Control Units		

**Table 2. Analog value (continued)**

Object Identifier	Object Name	Description	Units	Valid Range	VVDA <sup>(a)</sup>	CVDA <sup>(b)</sup>	VVZT <sup>(c)</sup>	CVZT <sup>(d)</sup>	When Exists	Last One Wins <sup>(e)</sup>	Heartbeat <sup>(f)</sup>
AV-10160	Occupied Heating Setpoint BAS	The value is normally provided by the BAS to define the occupied heating setpoint when both heating and cooling setpoints are provided in lieu of a single setpoint	Degrees Fahrenheit	40.0 to 115.0 °F					X		Heat Present and Zone Temperature Control
AV-10161	Occupied Standby Cooling Setpoint BAS	The value is normally provided by the BAS to define the occupied standby cooling setpoint when both heating and cooling setpoints are provided in lieu of a single setpoint	Degrees Fahrenheit	40.0 to 115.0 °F					X		Zone Temperature Control Units
AV-10162	Occupied Standby Heating Setpoint BAS	Indicates the active occupied standby heating setpoint being used by the controller, considering all possible sources	Degrees Fahrenheit	40.0 to 115.0 °F					X		Heat Present and Zone Temperature Control
AV-10163	Demand Limit Setpoint	This value is normally provided by the BAS to demand limit the unit. Demand Limit Request BAS must be set to "Limited" in order for the value to have meaning.	Percent	-163.84 to 163.83 %					X		All Packaged RTU
AV-10164	Evaporator Leaving Air Temperature Setpoint	Normally provided by the BAS to request the evaporator leaving air temperature setpoint.	Degrees Fahrenheit	40 to 55°F					X		Hot Gas Reheat Present
AV-10165	Pre Cool Setpoint	Normally provided by the BAS, defines the space temperature above which pre-cool will be exercised, when enabled	Degrees Fahrenheit	40 to 90°F					X		All Packaged RTU
										X	

**Table 2. Analog value (continued)**

Object Identifier	Object Name	Description	Units	Valid Range	VVDA <sup>(a)</sup>	CVDA <sup>(b)</sup>	VZT <sup>(c)</sup>	CVZT <sup>(d)</sup>	When Exists	Last One Wins <sup>(e)</sup>	Heartbeat <sup>(f)</sup>
AV-10166	Discharge Air Temperature Maximum Heat Limit	Indicates the discharge air temperature maximum heat limit, above which a high temperature diagnostic will be generated. This value can be provided by the BAS.	Degrees Fahrenheit	40 to 140°F					X	X	Heat Present and Zone Temperature Control
AV-10167	Discharge Air Temperature Minimum Cool Limit	Indicates the discharge air temperature minimum cool limit, below which a low temperature diagnostic will be generated. This value can be provided by the BAS.	Degrees Fahrenheit	40 to 80°F					X	X	Zone Temperature Control Units
AV-10168	Exhaust Enable Position Setpoint	Normally provided by the BAS to indicate the outdoor air damper position above which the exhaust sequence is enabled	Percent	0.0 to 100.0 %					X	X	Relief/Exhaust Fan Present
AV-10169	Occupied Bypass Time	Normally used by the BAS to configure the occupied bypass time. The occupied bypass time is the amount of time the controller will be overridden when an occupancy request is initiated during the unoccupied mode.	No Units	0 to 240 minutes					X	X	All Packaged RTU
AV-10170	Economizing Enthalpy Enable Setpoint	Related to the economizer enable decision, this value is normally provided by the BAS to determine the outdoor air enthalpy below which economizing is enabled.	BTUs per Pound	0 to 80 BTU/lbm					X	X	Economizer with Reference or Comparative Enthalpy
AV-10175	Space CO2 High Limit	Normally provided by the BAS to define the CO2 high limit, for ventilation purposes	Parts Per Million	0 to 2000 ppm					X	X	Economizer with TRAQ or Demand Control Ventilation

**Table 2. Analog value (continued)**

Object Identifier	Object Name	Description	Units	Valid Range	VVDA <sup>(a)</sup>	CVDA <sup>(b)</sup>	VVZT <sup>(c)</sup>	CVZT <sup>(c)</sup>	When Exists	Last One Wins <sup>(e)</sup>	Heartbeat <sup>(f)</sup>
AV-10176	Space CO2 Low Limit	Normally provided by the BAS to define the CO2 low limit	Parts Per Million	0 to 2000 ppm	X	X	X	X	X	Economizer with TRAQ or Demand Control Ventilation	X
AV-10177	Supply Fan Speed Setpoint External Heat	Specifies the supply fan speed setpoint during external heat modes of operation.	Percent	0.0 to 100.0 %			X			Single-zone VAV	X
AV-10178	Discharge Air Temperature Maximum Cool Limit	Normally used by BAS to limit space temperature control calculated cooling setpoint	Degrees Fahrenheit	39.9 to 80.1°F			X		X	Zone Temperature Control Units	
AV-10179	Discharge Air Temperature Minimum Heat Limit	Normally used by BAS to limit space temperature control calculated heating setpoint	Degrees Fahrenheit	39.9 to 140.1°F			X		X	Zone Temperature Control Units w/ Heat	
AV-10180	Space Dew Point Setpoint BAS	Normally used by the BAS to define the dew point temperature setpoint used for dehumidification control in occupied mode	Degrees Fahrenheit	40 to 70°F	X		X		X	Hot Gas Reheat Present	
AV-10181	Space Dew Point Unocc Setpoint BAS	Normally used by the BAS to define the dew point temperature setpoint used for dehumidification control in unoccupied mode	Degrees Fahrenheit	40 to 75°F	X		X		X	Hot Gas Reheat Present	

(a) VVDA - Variable Volume Discharge Air Temperature Control

(b) CVDA - Constant Volume Discharge Air Temperature Control

(c) VVZT - Variable Volume Zone Temperature Control

(d) CVZT - Constant Volume Zone Temperature Control

(e) Last written value is persisted; not subject to a priority array

(f) Heartbeat values must be written at least once every 15 minutes (recommend 5 minutes). Arbitrator points are not intended to be written to.



## Points List

**Table 3. Binary input**

Object Identifier	Object Name	Description	Object States	VVDA <sup>(a)</sup>	CVDA <sup>(b)</sup>	VVZT <sup>(c)</sup>	CVZT <sup>(d)</sup>	When Exists
BI-10001	microSD	Indicates when a micro SD card is present	0 = MicroSD card is not present 1 = MicroSD card is present	X	X	X	X	All Packaged RTU
BI-10002	USB Port 1	Indicates when a USB device is present in port 1.	0 = USB device is not present 1 = USB device is present	X	X	X	X	All Packaged RTU
BI-10003	USB Port 2	Indicates when a USB device is present in port 2	0 = USB device is not present 1 = USB device is present	X	X	X	X	All Packaged RTU
BI-10004	USB Port 3	Indicates when a USB device is present in port 3	0 = USB device is not present 1 = USB device is present	X	X	X	X	All Packaged RTU
BI-10005	USB Port 4	Indicates when a USB device is present in port 4	0 = USB device is not present 1 = USB device is present	X	X	X	X	All Packaged RTU
BI-10105	FDD: Unit Economizing When It Should Not	FDD: Indicates when the unit is economizing but should not be	0 = Inactive 1 = Active	X	X	X	X	Economizer Present
BI-10106	FDD: Unit Not Economizing When it Should Be	FDD: Indicates when the unit is not economizing but should be	0 = Inactive 1 = Active	X	X	X	X	Economizer Present
BI-10107	FDD: Excessive Outdoor Air	FDD: Indicates an excessive outdoor air condition	0 = Inactive 1 = Active	X	X	X	X	Economizer Present
BI-10108	FDD: Outdoor Air Damper Not Modulating	FDD: Indicates when the outdoor air damper is not modulating but should be	0 = Inactive 1 = Active	X	X	X	X	Economizer Present
BI-10111	Compressor 1A Status	Indicates the operating status of compressor 1A	0 = Off 1 = Running	X	X	X	X	All Packaged RTU
BI-10112	Compressor 1B Status	Indicates the operating status of compressor 1B	0 = Off 1 = Running	X	X	X	X	All Packaged RTU, 20-75T
BI-10113	Compressor 1C Status	Indicates the operating status of compressor 1C	0 = Off 1 = Running	X	X	X	X	All Packaged RTU, 20-30T
BI-10114	Compressor 2A Status	Indicates the operating status of compressor 2A	0 = Off 1 = Running	X	X	X	X	All Packaged RTU, 40-75T
BI-10115	Compressor 2B Status	Indicates the operating status of compressor 2B	0 = Off 1 = Running	X	X	X	X	All Packaged RTU, 40-75T
BI-10132	FDD: Outdoor Air Temperature Sensor Failure	FDD: Indicates when the outdoor air temperature sensor has failed	0 = Normal 1 = Outdoor Air Temp Sensor Fail	X	X	X	X	Economizer Present
BI-10140	Unit Running State	Indicates whether the unit is off or on	0 = Off 1 = On	X	X	X	X	All Packaged RTU

**Table 3. Binary input (continued)**

Object Identifier	Object Name	Description	Object States	VVDA <sup>(a)</sup>	CVDA <sup>(b)</sup>	VVZT <sup>(c)</sup>	CVZT <sup>(d)</sup>	When Exists
BI-10143	VAV Box Command	Indicates whether the associated VAV boxes should be allowed to be in automatic control or forced wide open	0 = Auto 1 = Open	X	X			Multiple-zone VAV Units
BI-10144	Alarm Relay Output Status	Indicates the state of the alarm output of the controller	0 = De-energized 1 = Energized	X	X	X	X	All Packaged RTU
BI-10154	Supply Fan Configuration Status	Indicates the supply fan configuration	0 = Cycling 1 = Continuous			X	X	Zone Temperature Control Units
BI-10155	Rapid Restart Status	Indicates the active status of the Rapid Restart event	0 = Inactive 1 = Active	X	X	X	X	Rapid Restart Control
BI-10161	Morning Warmup Active	Indicates the active status of the Morning Warmup event	0 = Inactive 1 = Active	X	X	X	X	Heat Present
BI-10162	Daytime Warmup Active	Indicates the active status of the Daytime Warmup event	0 = Inactive 1 = Active	X	X			Discharge Air Temperature Control and Heat Present
BI-10164	Coil Frost Protection Status Circuit 1	Indicates the status of evaporator frost protection function for circuit 1	0 = Inactive 1 = Active	X	X	X	X	All Packaged RTU
BI-10165	Coil Frost Protection Status Circuit 2	Indicates the status of evaporator frost protection function for circuit 2	0 = Inactive 1 = Active	X	X	X	X	All Packaged RTU, 40-75T
BI-10170	Condensate Overflow Input	Indicates the status of the condensate overflow input	0 = Normal 1 = Overflow	X	X	X	X	Condensate Overflow Switch Present
BI-10172	Occupancy Input	Indicates the status of the occupancy input (see below)	0 = Occupied 1 = Unoccupied	X	X	X	X	All Packaged RTU
BI-10173	Precool Active	Indicates when the pre-cool mode is active	0 = Inactive 1 = Active	X	X	X	X	All Packaged RTU
BI-10174	Supply Air Tempering Status	Indicates whether or not the supply air tempering feature is enabled	0 = Disabled 1 = Enabled	X	X			Modulating Gas Heat or Modulating Electric Heat
BI-10175	Timed Override Timer Is Active	Indicates whether or not the timed override timer is active	0 = Inactive 1 = Active	X	X	X	X	All Packaged RTU
BI-10176	Diagnostic Present	Diagnostic Present	0 = Normal 1 = In Alarm	X	X	X	X	All Packaged RTU
BI-10201	Changeover Input	Indicates the status of the (heat/cool) changeover input	0 = Heating 1 = Cooling	X	X			Discharge Air Temperature Control and Heat Present



## Points List

**Table 3. Binary input (continued)**

Object Identifier	Object Name	Description	Object States	VVDA <sup>(a)</sup>	CVDA <sup>(b)</sup>	VVZT <sup>(c)</sup>	CVZT <sup>(d)</sup>	When Exists
BI-10202	Condenser Fan Circuit 1 Relay 1 Status	Indicates the status of condenser fan circuit 1, relay 1	0 = Off 1 = On	X	X	X	X	Standard Ambient Condenser Control Present
BI-10203	Condenser Fan Circuit 1 Relay 2 Status	Indicates the status of condenser fan circuit 1, relay 2	0 = Off 1 = On	X	X	X	X	All Packaged RTU
BI-10204	Condenser Fan Circuit 1 Relay 3 Status	Indicates the status of condenser fan circuit 1, relay 3	0 = Off 1 = On	X	X	X	X	All Packaged RTU, 60-75T
BI-10205	Condenser Fan Circuit 1 Relay 4 Status	Indicates the status of condenser fan circuit 1, relay 4	0 = Off 1 = On	X	X	X	X	All Packaged RTU, 90-130T
BI-10206	Condenser Fan Circuit 2 Relay 1 Status	Indicates the status of condenser fan circuit 2, relay 1	0 = Off 1 = On	X	X	X	X	Standard Ambient Condenser Control Present
BI-10207	Condenser Fan Circuit 2 Relay 2 Status	Indicates the status of condenser fan circuit 2, relay 2	0 = Off 1 = On	X	X	X	X	All Packaged RTU, 40-75T
BI-10208	Condenser Fan Circuit 2 Relay 3 Status	Indicates the status of condenser fan circuit 2, relay 3	0 = Off 1 = On	X	X	X	X	All Packaged RTU, 60-75T
BI-10209	Condenser Fan Circuit 2 Relay 4 Status	Indicates the status of condenser fan circuit 2, relay 4	0 = Off 1 = On	X	X	X	X	All Packaged RTU, 90-130T
BI-10210	Emergency Stop	Indicates the status of the emergency stop function of the unit	0 = Auto 1 = Emergency Stop - Manual Reset Required	X	X	X	X	All Packaged RTU
BI-10211	External Auto Stop Input Status	Indicates the status of the externally-wired auto/stop input	0 = Stop 1 = Auto	X	X	X	X	All Packaged RTU
BI-10212	Supply Fan Bypass Status	Indicates the status of the supply fan bypass from the variable frequency drive (VFD)	0 = Off 1 = On	X	X	X	X	Supply Fan VFD Bypass Present
BI-10213	Ventilation Mode A Local	Indicates when the controller is actively in the Ventilation Override Mode A	0 = Inactive 1 = Active	X	X	X	X	Ventilation Override Present
BI-10214	Ventilation Mode B Local	Indicates when the controller is actively in the Ventilation Override Mode B	0 = Inactive 1 = Active	X	X	X	X	Ventilation Override Present
BI-10215	Ventilation Mode C Local	Indicates when the controller is actively in the Ventilation Override Mode C	0 = Inactive 1 = Active	X	X	X	X	Ventilation Override Present

**Table 3. Binary input (continued)**

Object Identifier	Object Name	Description	Object States	VVDA <sup>(a)</sup>	CVDA <sup>(b)</sup>	VVZT <sup>(c)</sup>	CVZT <sup>(d)</sup>	When Exists
BI-10216	Ventilation Mode D Local	Indicates when the controller is actively in the Ventilation Override Mode D	0 = Inactive 1 = Active	X	X	X	X	Ventilation Override Present
BI-10217	Ventilation Mode E Local	Indicates when the controller is actively in the Ventilation Override Mode E	0 = Inactive 1 = Active	X	X	X	X	Ventilation Override Present
BI-10218	Diagnostic: Manual Reset Required	Indicates when a diagnostic exists that requires manual reset	0 = Normal 1 = In Alarm	X	X	X	X	All Packaged RTU
BI-10219	Economizer Airside Status	Indicates the status of airside economizing. This value will be true when airside economizing is active/enabled.	0 = Inactive 1 = Active	X	X	X	X	Economizer Present
BI-10221	Exhaust Fan Output Status	Indicates the status of the exhaust fan output on the controller	0 = Off 1 = On	X	X	X	X	Relief/Exhaust Fan Present
BI-10222	Heat Output 1 Status	Indicates the commanded state of heating output 1	0 = Off 1 = On	X	X	X	X	Heat Present
BI-10223	Heat Output 2 Status	Indicates the commanded state of heating output 2	0 = Off 1 = On	X	X	X	X	Heat Present
BI-10224	Heat Output 3 Status	Indicates the commanded state of heating output 3	0 = Off 1 = On	X	X	X	X	Heat Present
BI-10225	Heat Output 4 Status	Indicates the commanded state of heating output 4	0 = Off 1 = On	X	X	X	X	Heat Present
BI-10226	Supply Fan Output Status	Indicates the status of the supply fan output of the controller	0 = Off 1 = On	X	X	X	X	All Packaged RTU
BI-10603	Diagnostic: Discharge Air High Temperature Detected	Indicates when a discharge air high temperature diagnostic is present	0 = No 1 = Yes	X	X	X	X	All Packaged RTU
BI-10605	Diagnostic: Loss of Charge Lockout Ckt1	Indicates when a loss of charge lockout diagnostic exists for DX circuit 1	0 = No 1 = Yes	X	X	X	X	All Packaged RTU
BI-10606	Diagnostic: Loss of Charge Lockout Ckt2	Indicates when a loss of charge lockout diagnostic exists for DX circuit 2	0 = No 1 = Yes	X	X	X	X	All Packaged RTU, 40-75T
BI-10608	Diagnostic: Morning Warmup Mode Exceeded 120 Minutes	Indicates when the morning warmup mode has exceeded 120 consecutive minutes	0 = No 1 = Yes	X	X	X	X	Heat Present



## Points List

**Table 3. Binary input (continued)**

Object Identifier	Object Name	Description	Object States	VVDA <sup>(a)</sup>	CVDA <sup>(b)</sup>	VVZT <sup>(c)</sup>	CVZT <sup>(d)</sup>	When Exists
BI-10609	Diagnostic: Pre Cool Mode Exceeded 120 Minutes	Indicates when the pre-cool mode has exceeded 120 consecutive minutes	0 = No 1 = Yes	X	X	X	X	All Packaged RTU
BI-10611	Diagnostic: Return Air High Temperature Detected	Indicates when a return air high temperature diagnostic is present	0 = No 1 = Yes	X	X	X	X	Economizer with Comparative Enthalpy
BI-10614	Diagnostic: Condensate Overflow Lockout	Indicates when a condensate overflow lockout diagnostic is present	0 = No 1 = Yes	X	X	X	X	Condensate Overflow Switch Present
BI-10615	Diagnostic: High Condensate Level Detected	Indicates when a high condensate level is detected	0 = No 1 = Yes	X	X	X	X	Condensate Overflow Switch Present
BI-10616	Supply Fan Speed Control Enabled	Supply fan speed is controlled via Supply Fan Speed Setpoint. If disabled/inactive, supply fan speed control is under local control.	0 = Inactive 1 = Active	X		X		Variable Volume Supply Fan Control
BI-10617	Supply Fan Speed Limited	Supply fan speed is being increased or decreased due to a limit control action	0 = Not Limited 1 = Limited	X		X		Variable Volume Supply Fan Control
BI-10618	Exhaust Fan Speed Control Enabled	Exhaust fan speed is controlled via Exhaust Fan Speed Setpoint. If disabled/ inactive, supply fan speed control is under local control.	0 = Inactive 1 = Active	X	X	X	X	Relief/Exhaust Fan Present
BI-10619	Diagnostic Shutdown Present	Unit is shut down due to diagnostics	0 = Normal 1 = In Alarm	X	X	X	X	All Packaged RTU
BI-10620	Diagnostic: Local Manual Reset Required	Diagnostic Reset required [Local only]	0 = Normal 1 = In Alarm	X	X	X	X	All Packaged RTU
BI-10622	Exhaust Fan Bypass Status	Indicates the status of the exhaust fan bypass from the variable frequency drive (VFD)	0 = Off 1 = On	X	X	X	X	Exhaust Fan VFD Bypass Present
BI-10623	Return Fan Bypass Status	Indicates the status of the return fan bypass from the variable frequency drive (VFD)	0 = Off 1 = On	X	X	X	X	Return Fan VFD Bypass Present

(a) VVDA - Variable Volume Discharge Air Temperature Control

(b) CVDA - Constant Volume Discharge Air Temperature Control

(c) VVZT - Variable Volume Zone Temperature Control

(d) CVZT - Constant Volume Zone Temperature Control

**Table 4. Binary values**

Object Identifier	Object Name	Description	Relinquish Default	Object States (a)	VVDA <sup>(b)</sup>	CVDA <sup>(c)</sup>	VVZT <sup>(d)</sup>	CVZT <sup>(e)</sup>	When Exists	Last One Wins <sup>(f)</sup>
BV-10103	HeatLockout Command	Normally used by the BAS to command the unit to prevent heating operation	0 Normal 1 = Locked Out	X	X	X	X	X	Heat Present	
BV-10104	Supply Fan Configuration Command	Normally used by the BAS to command the unit supply fan configuration as either cycling or continuous	1 Continuous	0 = Cycling 1 = Continuous			X	X	Zone Temperature Control	
BV-10106	Dehumidification Enable Command	Normally used by the BAS to disable unit dehumidification	0 Disable 1 = Auto	0 = Disable 1 = Auto	X	X	X	X	Hot Gas Reheat Present	X
BV-10110	Reset Diagnostic	Normally used by the BAS to initiate a request to reset any controller diagnostics	0 Normal	0 = Normal 1 = Reset	X	X	X	X	All Packaged RTU	X
BV-10111	Daytime Warmup Enable Command	Normally used by the BAS to enable daytime warmup	1 Enable	0 = Disable 1 = Enable	X	X			Discharge Air Temperature Control and Heat Present	X
BV-10112	Morning Warmup Enable Command	Normally used by the BAS to enable morning warmup	1 Enable	0 = Disable 1 = Enable	X	X	X	X	Heat Present	X
BV-10113	Occupancy Input BAS	Normally used by the BAS to provide the requested occupancy state to the unit	1 Unoccupied	0 = Occupied 1 =Unoccupied	X	X	X	X	All Packaged RTU	
BV-10115	Cooling Lockout BAS	Normally used by the BAS as a command to (temporarily) prevent all mechanical cooling	0 Normal	0 = Normal 1 = Locked Out	X	X	X	X	All Packaged RTU	
BV-10116	Demand Limit Request BAS	This command is normally provided by the BAS to demand limit the unit. The command is used in conjunction with Demand Limit Setpoint to determine the percentage the unit will be limited.		0 Not Limited 1 = Limited					All Packaged RTU	
BV-10117	Energy Consumption Reset	Normally used by the BAS to reset the energy consumption accumulated total	0 Accumulating 1 = Reset		X	X	X	X	Power Monitoring Present	X
BV-10118	Pre Cool [Enable] Command	Normally used by the BAS to enable pre-cool	1 Enable	0 = Disable 1 = Enable	X	X	X	X	All Packaged RTU	X



## Points List

**Table 4. Binary values (continued)**

Object Identifier	Object Name	Description	Relinquish Default	Object States (a)	VVDA <sup>(b)</sup>	CVDA <sup>(c)</sup>	VVZT <sup>(d)</sup>	CVZT <sup>(e)</sup>	When Exists	Last One Wins <sup>(f)</sup>
BV-10119	Supply Air Tempering Enable	Normally used by the BAS to enable the supply (discharge) air tempering feature of the unit	0 Disable 1 = Enable		X				Modulating Gas Primary Heat Present	X
BV-10120	Rapid Restart Enable	Enables/Disables rapid restart operation	0 Disable 1 = Enable		X		X	X	Rapid Restart Control	X
BV-10121	Rapid Restart Economizer Enable	Enables/Disables economizer evaluation during rapid restart operation	0 Disable 1 = Enable		X		X	X	Rapid Restart Control	X
BV-10122	Supply Fan Speed Setpoint Enable	Enables Supply Fan Speed Setpoint control	0 Disable 1 = Enable		X		X	X	Variable Volume Supply Fan Control	
BV-10123	Exhaust Fan Speed Setpoint Enable	Enables Exhaust Fan Speed Setpoint control	0 Disable 1 = Enable		X		X	X	Relief/Exhaust Fan Present	
BV-10124	Supply Fan Compensation	Enables the outdoor air damper position to compensate for changes in supply fan speed	0 Disable 1 = Enable		X		X	X	Economizer Present	X
BV-10125	Energy Consumption Reset Meter 2	Normally used by the BAS to reset the energy consumption accumulated total for second power meter	0 Accumulating 1 = Reset		X		X	X	Dual Power Monitoring Present	X

(a) Binary Values are signed 16-bit integers with 0=false, 1=true, -1=invalid.

(b) VVDA - Variable Volume Discharge Air Temperature Control

(c) CVDA - Constant Volume Discharge Air Temperature Control

(d) VVZT - Variable Volume Zone Temperature Control

(e) CVZT - Constant Volume Zone Temperature Control

(f) Last written value is persisted; not subject to a priority array

**Table 5. Multi-state input**

Object Identifier	Object Name	Description	Object States	VVDA <sup>(a)</sup>	CVDA <sup>(b)</sup>	VVZT <sup>(c)</sup>	CVZT <sup>(d)</sup>	When Exists
MI-10101	Heat Cool Mode Status	Indicates the current heat cool mode of the controller	1 = Auto 2 = Heat 3 = Morning Warm-up 4 = Cool 5 = Night Purge 6 = Pre Cool 7 = Off 8 = Test 9 = Emergency Heat 10 = Fan Only 11 = Free Cool 12 = Ice-Making 13 = Max Heat 14 = Economizer 15 = Dehumidify 16 = Calibrate	X	X	X	X	All Packaged RTU
MI-10102	Ventilation Override Status	Indicates which of the 5 preprogrammed ventilation override modes is operations, when applicable	1 = Inactive 2 = Mode A Active 3 = Mode B Active 4 = Mode C Active 5 = Mode D Active 6 = Mode E Active	X	X	X	X	Ventilation Override Present
MI-10103	Occupancy Status	Indicates the active occupancy mode of the controller	1 = Occupied 2 = Unoccupied 3 = Occupied Bypass 4 = Occupied Standby 5 = Auto	X	X	X	X	All Packaged RTU
MI-10105	Cooling Reset Type Status	Indicates the type of cooling reset used by the controller	1 = None 2 = Outdoor Air 3 = Zone 4 = Return Air	X	X			Discharge Air Temperature Control
MI-10106	Heating Reset Type Status	Indicates the type of heating reset used, when applicable	1 = None 2 = Outdoor Air 3 = Zone	X	X			Discharge Air Temperature Control and Heat Present
MI-10107	Trane Unit Type	Indicates the equipment type according to the manufacturer's classification	1 = 1 Heat/1 Cool 2 = Heat Pump 3 = Blower Coil 4 = Unit Ventilator 5 = Fan Coil 6 = Rooftop 7 = Air Handler 8 = Vertical Self Contained 9 = Unitary 10 = VAV Box 11 = Fan Coil	X	X	X	X	All Packaged RTU



## Points List

**Table 5. Multi-state input (continued)**

Object Identifier	Object Name	Description	Object States	VVDA <sup>(a)</sup>	CVDA <sup>(b)</sup>	VVZT <sup>(c)</sup>	CVZT <sup>(d)</sup>	When Exists
MI-10108	Economizer Type	Indicates the general description of the type of economizer system	1 = None 2 = 2 Position Ventilation 3 = Modulation Economizer 4 = 2 Position Ventilation/ Waterside Economizer 5 = Waterside Economizer 6 = Airside/ Waterside Economizer 7 = TRAQ Damper 8 = Airside Economizer and TRAQ Damper/ Sensor 9 = Waterside Economizer and TRAQ Damper/ Sensor 10 = Airside/ Waterside Economizer and TRAQ Damper/ Sensor	X	X	X	X	All Packaged RTU
MI-10109	Condenser Type	Indicates the general description of the equipment condenser system	1 = None 2 = Air Cooled Condenser 3 = Water Cooled Condenser 4 = Evaporative Condenser	X	X	X	X	All Packaged RTU
MI-10117	Refrigerant Type	Indicates the type of refrigerant used in the equipment	1 = R-11 2 = R-12 3 = R-22 4 = R-123 5 = R-134A 6 = R-407C 7 = R-410A 8 = R-113 9 = R-114 10 = R-500 11 = R-502 12 = R-404A 13 = R-513A 14 = R-1233zd (E) 15 = R-514A 16 = R-1234ze (E)	X	X	X	X	All Packaged RTU
MI-10118	System Mode Switch Local	Indicates the status of the system mode switch connected to the controller	1 = Off 2 = Auto 3 = Cool 4 = Heat 5 = Emergency Heat			X	X	Zone Temperature Control

**Table 5. Multi-state input (continued)**

Object Identifier	Object Name	Description	Object States	VVDA <sup>(a)</sup>	CVDA <sup>(b)</sup>	VVZT <sup>(c)</sup>	CVZT <sup>(d)</sup>	When Exists
MI-10119	Arbitration Method	The arbitration method is used to define the source of the data being provided to the controller. The source can be defined as DEFAULT (stored in the controller, such as setpoints and settings), LOCAL (for wired/wireless sensors), or FULL (for all remote sources, including BMS, custom programming, etc.).	1 = Full (Auto) 2 = Local 3 = Default	X	X	X	X	All Packaged RTU
MI-10120	Timed Override Request Active	Indicates the status of the timed override request (see above)	1 = Idle 2 = On 3 = Cancel	X	X	X	X	All Packaged RTU
MI-10121	Electrical Service Type	Indicates the electrical service type used for the unit	1 = A+N 2 = A+B 3 = A+B+N 4 = A+B+C 5 = A+B+C+N	X	X	X	X	Power Monitoring Present
MI-10132	Economizer Decision Method	Normally provided by the BAS to determine the method of enabling airside economizing	1 = Absolute Temperature 2 = Relative Temperature 3 = Absolute Enthalpy 4 = Comparative Enthalpy	X	X	X	X	Economizer present
MI-10144	Economizer System Status	Indicates the status of enabling economizing	1 = Disabled 2 = Enabled 3 = Not Present	X	X	X	X	Economizer present
MI-10145	Model Information [GEN2]	Indicates the type of equipment.	27 = IPAK	X	X	X	X	All Packaged RTU
MI-10146	Electrical Service Type Meter 2	Indicates the electrical service type used for the second power connection on the unit	1 = A+N 2 = A+B 3 = A+B+N 4 = A+B+C 5 = A+B+C+N	X	X	X	X	Dual Power Monitoring Present

(a) VVDA - Variable Volume Discharge Air Temperature Control

(b) CVDA - Constant Volume Discharge Air Temperature Control

(c) VVZT - Variable Volume Zone Temperature Control

(d) CVZT - Constant Volume Zone Temperature Control

**Table 6. Multi-state values**

Object Identifier	Object Name	Description	Object States	VVDA <sup>(a)</sup>	CVDA <sup>(b)</sup>	VVZT <sup>(c)</sup>	CVZT <sup>(d)</sup>	When Exists	Last One Wins <sup>(e)</sup>
MV-10102	Emergency Override BAS	Normally used by the BAS to command the unit into an emergency mode of operation	1 = Normal 2 = Pressurize 3 = Depressurize 4 = Purge 5 = Shutdown 6 = Fire	X	X	X	X	All Packaged RTU	
MV-10103	Economizer Airside Enable BAS	Normally provided by the BAS to enable airside economizing	1 = Disabled 2 = Enabled 3 = Auto	X	X	X	X	Economizer present	



## Points List

---

**Table 6. Multi-state values (continued)**

Object Identifier	Object Name	Description	Object States	VVDA <sup>(a)</sup>	CVDA <sup>(b)</sup>	VVZT <sup>(c)</sup>	CVZT <sup>(d)</sup>	When Exists	Last One Wins <sup>(e)</sup>
MV-10104	Heat Cool Mode Request	Normally provided by the BAS to command the unit into a heat/cool mode, including additional possible control modes	1 = Auto 2 = Heat 3 = Morning Warm-up 4 = Cool 5 = Night Purge 6 = Pre Cool 7 = Off 8 = Test 9 = Emergency Heat 10 = Fan Only 11 = Free Cool 12 = Ice-Making 13 = Max Heat 14 = Economizer 15 = Dehumidify 16 = Calibrate	X	X	X	X	All Packaged RTU	
MV-10106	Occupancy Request	Normally used by the BAS to command the unit into an occupancy mode	1 = Occupied 2 = Unoccupied 3 = Occupied Bypass 4 = Occupied Standby 5 = Auto	X	X	X	X	All Packaged RTU	
MV-10110	Timed Override Request	Normally used by the BAS to request a temporary timed override during unoccupied	1 = Idle 2 = On 3 = Cancel	X	X	X	X	All Packaged RTU	
MV-10111	Dehumidification Method	Normally used by the BAS to select how the unit determines when to dehumidify.	1 = Relative Humidity 2 = Dew Point	X	X	X	X	Hot Gas Reheat Present	X

(a) VVDA - Variable Volume Discharge Air Temperature Control

(b) CVDA - Constant Volume Discharge Air Temperature Control

(c) VVZT - Variable Volume Zone Temperature Control

(d) CVZT - Constant Volume Zone Temperature Control


(e) Last written value is persisted; not subject to a priority array

## Recycled Points

The Symbio™ 800 controller ships from the factory pre-configured for the specific unit application. The points of the communicated interface (BACnet®, Modbus, or LonTalk®) vary based on the unit configuration. Only those points pertinent to that configuration are included in the interface.

Example: When the unit is configured for only two compressors, any points associated with compressors three and four are not be displayed on the Touch Screen interface or browser-based Web user interface. When configuration changes are made in the field, the points in the communication interface change accordingly to align with those features or user-added points.

**Figure 13. Points**

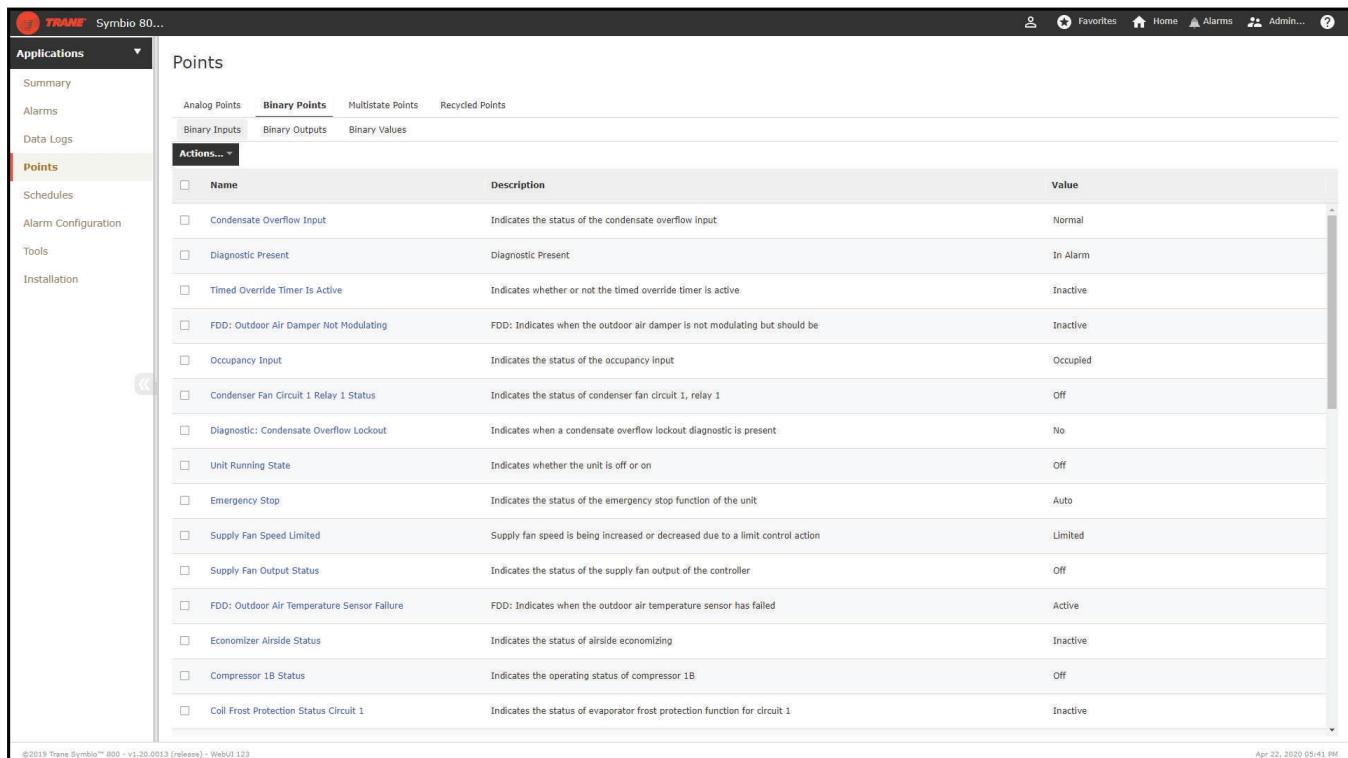

Name	Description	Value
Condensate Overflow Input	Indicates the status of the condensate overflow input	Normal
Diagnostic Present	Diagnostic Present	In Alarm
Timed Override Timer Is Active	Indicates whether or not the timed override timer is active	Inactive
FDD: Outdoor Air Damper Not Modulating	FDD: Indicates when the outdoor air damper is not modulating but should be	Inactive
Occupancy Input	Indicates the status of the occupancy input	Occupied
Condenser Fan Circuit 1 Relay 1 Status	Indicates the status of condenser fan circuit 1, relay 1	Off
Diagnostic: Condensate Overflow Lockout	Indicates when a condensate overflow lockout diagnostic is present	No
Unit Running State	Indicates whether the unit is off or on	Off
Emergency Stop	Indicates the status of the emergency stop function of the unit	Auto
Supply Fan Speed Limited	Supply fan speed is being increased or decreased due to a limit control action	Limited
Supply Fan Output Status	Indicates the status of the supply fan output of the controller	Off
FDD: Outdoor Air Temperature Sensor Failure	FDD: Indicates when the outdoor air temperature sensor has failed	Active
Economizer Airlside Status	Indicates the status of airlside economizing	Inactive
Compressor 1B Status	Indicates the operating status of compressor 1B	Off
Coil Frost Protection Status Circuit 1	Indicates the status of evaporator frost protection function for circuit 1	Inactive

Any of the factory-provided points can be removed from the communication interface through a feature known as recycling. When the user selects and deletes a factory point, that point is moved to Recycled Points and is removed from the interface. This feature offers technicians the ability to strategically provide only those interface points desired for a specific project or installation.

To remove a point from the interface:

1. On the left-hand navigation, select **Points**.
2. Each of the points are grouped by their native type (analog, binary or multi-state), and input, output, or value. Select the appropriate group at the top of the page.
3. Select one or more points from the list and select **Actions... | Delete**.



## Points List

Figure 14. Delete points


The screenshot shows the Trane Symbio 800 software interface. On the left, there's a navigation sidebar with options like Applications, Summary, Alarms, Data Logs, Points (which is selected), Schedules, Alarm Configuration, Tools, and Installation. The main area is titled 'Points' and has tabs for Analog Points, Binary Points (which is active), Multistate Points, and Recycled Points. Below these tabs is a sub-tab bar with Binary Inputs, Binary Outputs, and Binary Values. A large table lists various binary points with columns for Actions, Description, and Value. In the Actions column, a context menu is open over the 'Delete' option for the 'Diagnostic Present' row. The table includes rows for Condensate Overflow Input, Diagnostic Present (selected), Timed Override Timer Is Active, FDD: Outdoor Air Damper Not Modulating, Occupancy Input, Condenser Fan Circuit 1 Relay 1 Status, Diagnostic: Condensate Overflow Lockout (selected), Unit Running State (selected), Emergency Stop, Supply Fan Speed Limited, Supply Fan Output Status, FDD: Outdoor Air Temperature Sensor Failure, Economizer Airlside Status, Compressor 1B Status, and Coil Frost Protection Status Circuit 1.

**Note:** User-created points cannot be recycled. Instead, when the user selects and deletes user-created points, those points are permanently removed from the controller. Should the user decide later that one or more of the deleted user points are needed, they will need to be recreated.

To restore recycled points:

1. Navigate to the **Recycled Points** tab on the Points page.
2. Select one or more points to be restored, then click **Restore**.
3. Once the restore process is complete, the restored points are moved back to the appropriate tab depending on point type. The recycled points also appear in the communicated interface once they are restored.

**Figure 15. Recycled points tab**

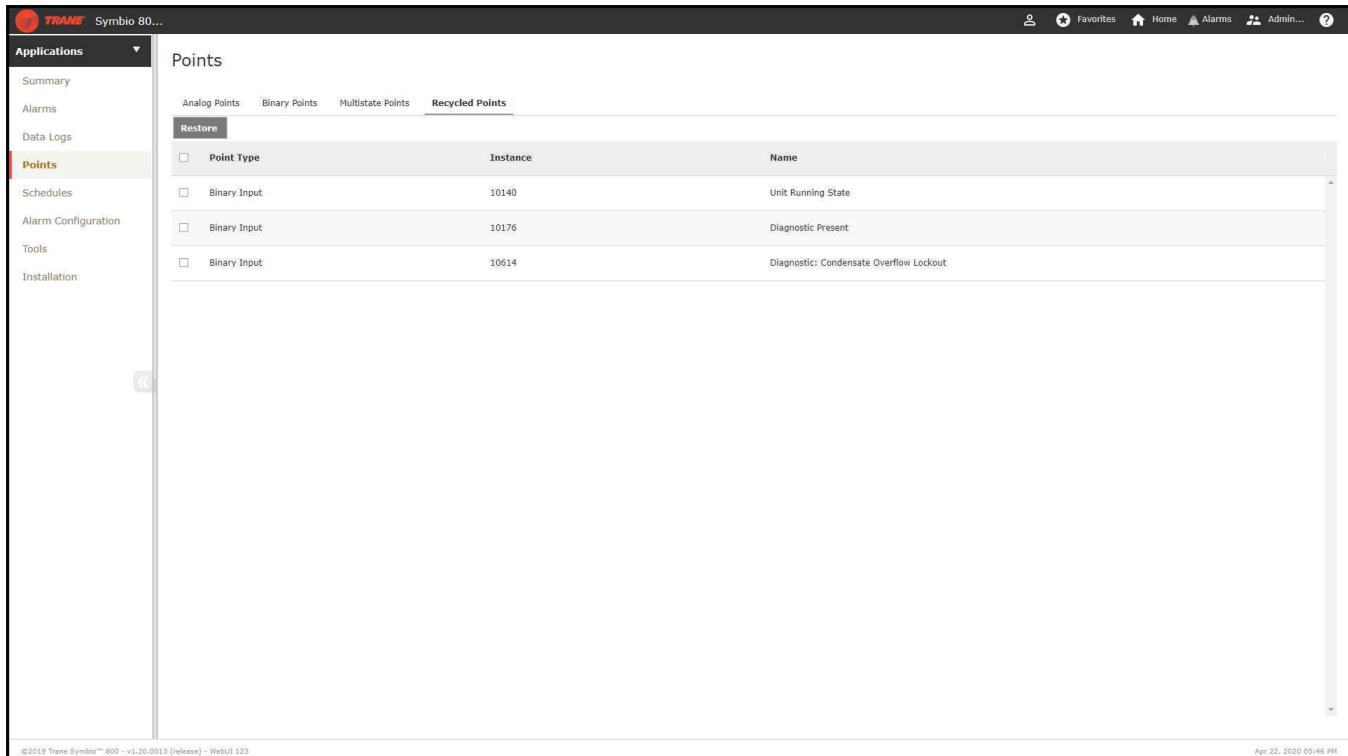

<input type="checkbox"/> Point Type	Instance	Name
<input type="checkbox"/> Binary Input	10140	Unit Running State
<input type="checkbox"/> Binary Input	10176	Diagnostic Present
<input type="checkbox"/> Binary Input	10614	Diagnostic: Condensate Overflow Lockout

## Appendix A. Arbitration


The Symbio™ 800 controller includes arbitration logic for several points. For each read/write point designated as “BAS”, an associated “Arbitration” point determines the behavior of that communicated data compared to the local hardwired (or wireless) sensor and a default value.

As shown in [Figure 16, p. A-1](#), the arbitrator considers all possible sources of the provided data, including Building Management Systems (BMS), local, and default. Each potential source is defined at a pre-determined, fixed priority. When the arbitration method is selected as full/auto, the BMS value is used instead of the local or default values.

The point designator with the arbitrator suffix includes the full priority array, allowing the user to see the value associated with all potential sources considered in the logic. The active point reflects the result of the arbitration logic.


Because the arbitrated points are normally associated with sensors, the default value is invalid, meaning the value must be provided either by the BMS or the local sensor.

**Figure 16. Arbitration method - full/auto**

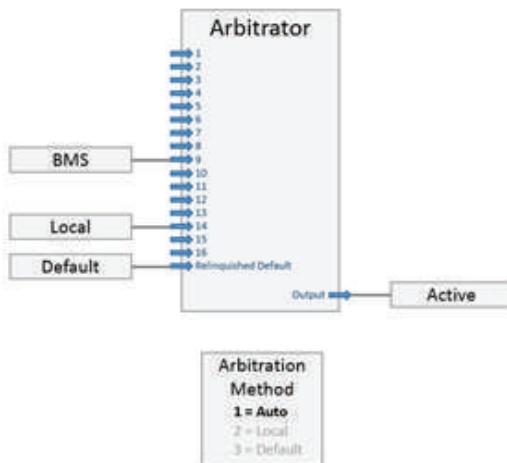

When the Arbitration Method is selected as local, the BMS value is ignored and local value is used instead. Though the arbitration logic still considers all inputs, any values sent by the BMS are effectively ignored.


**Figure 17. Arbitration method - local**

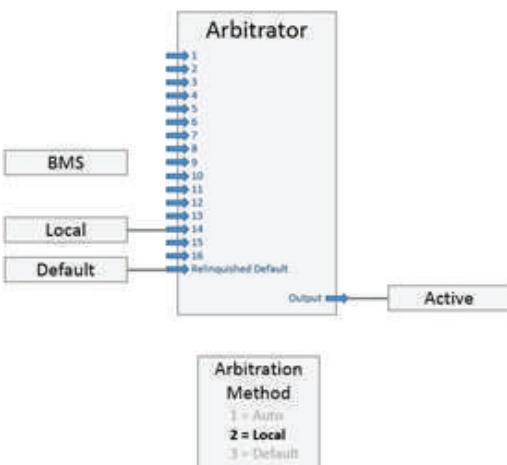



## Appendix B. Symbio™ 800 Controller Layout

Figure 18. Symbio™ 800 controller display and LEDs

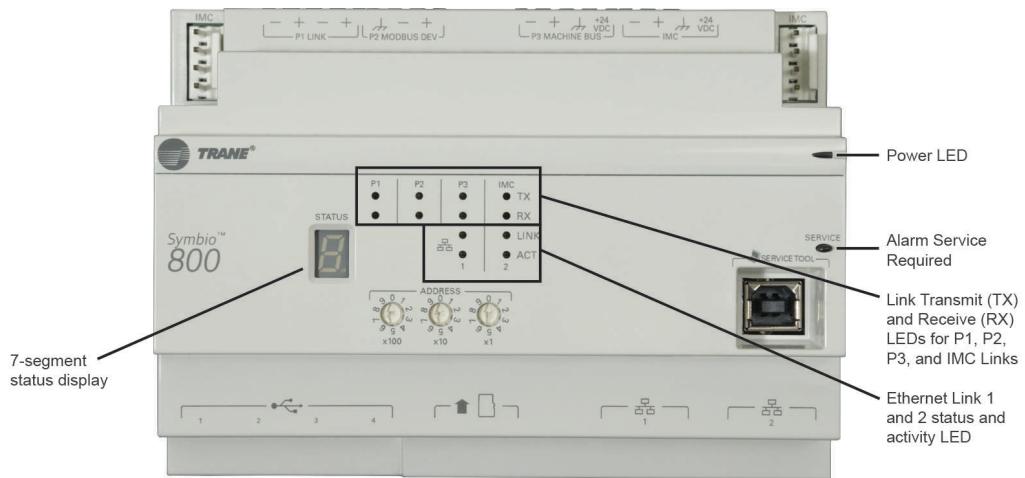

### 7-Segment status display

Table 7. Codes for 7-segment display segment

Code	Description
U0.	Waiting for USB drives to mount
U2.	Checking signature on the .scfw file
U3.	Checking software maintenance plan
U4.	Reformatting main filesystem (clearing database)
U5.	Beginning update
U12.	Searching for .scfw files on USB drive(s)
U51.	Updating main firmware
U54.	Updating FPGA image
U55.	Updating U-boot image
U57.	Updating recovery partition

**Note:** A code starting with an "F" indicates a failure, and requires Trane Service to resolve the issue.

#### P1 Link — BACnet MS/TP or Modbus RTU


- RS-485 daisy chain
- Used for connection to a manager controller



## Symbio™ 800 Controller Layout


**Figure 19. P2 Modbus device (factory installed Modbus server devices)**

**Note:** The P2 link is intended for factory devices only and should not have any other devices added this link.

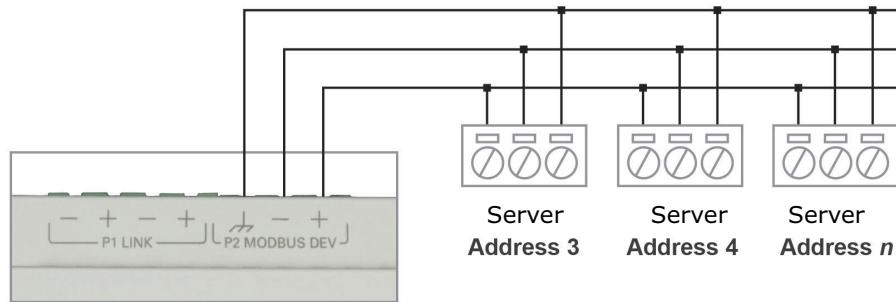


**Figure 20. P3 machine bus (global bus — internal communication bus)**

**Note:** The P3 link is intended for factory devices only and should not have any other devices added this link.

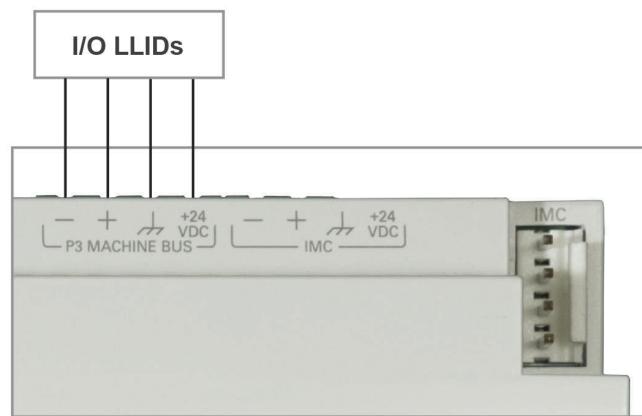


**Figure 21.** IMC link terminations for optional Air-Fi and expansion module (XM30)

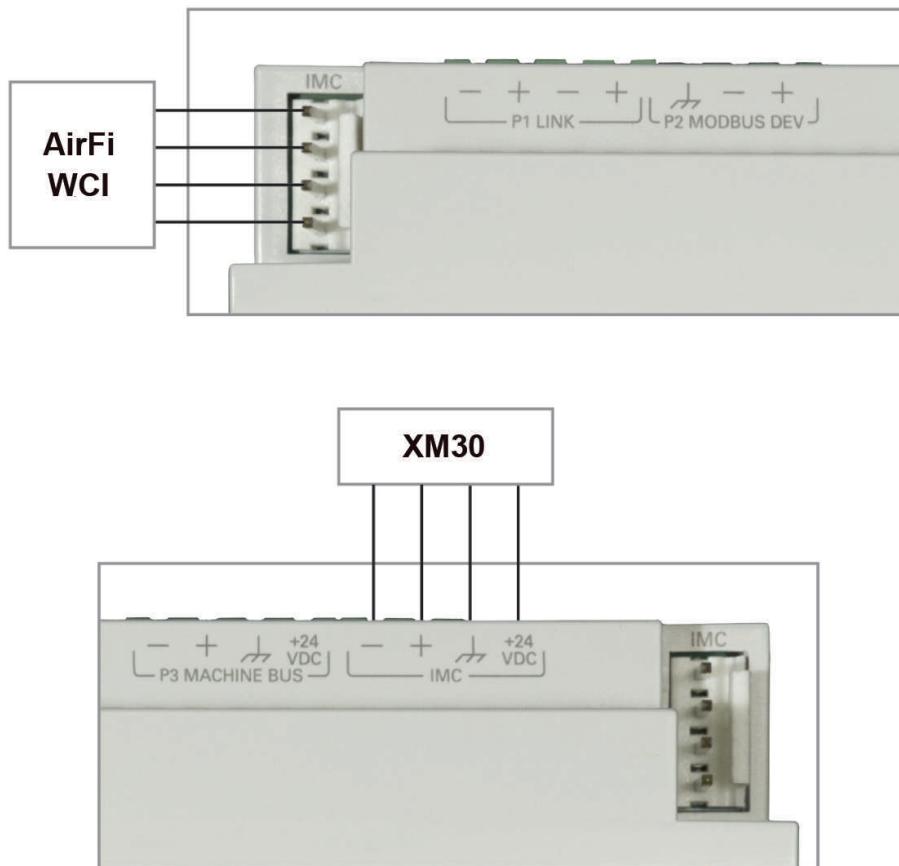

For more information on Expansion Module wiring reference *BAS-SVX46\** – *Expansion Module Installation Operation and Maintenance Manual*.

**Figure 22.** (4) USB connectors

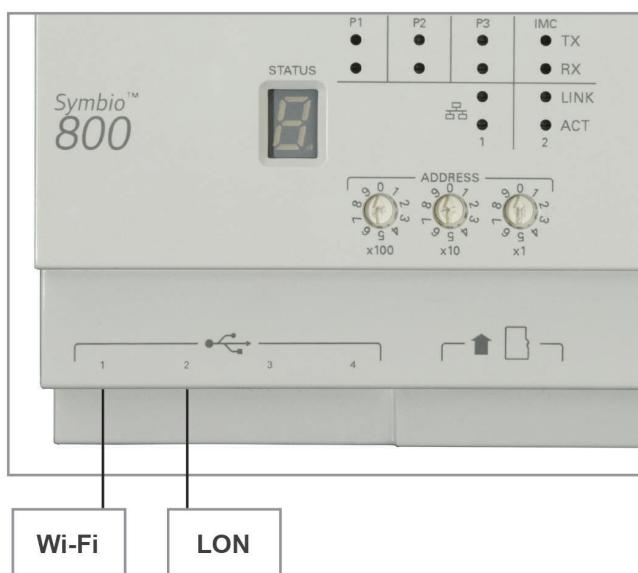




## Symbio™ 800 Controller Layout

The controller automatically detects devices on any of the ports (not port specific). The controller ships with all ports enabled, but they can be disabled via the Web interface.

**Note:** The USB ports are not to be used for any devices that are not Trane approved, such as cellular phones.

**Figure 23. Ethernet port 2**

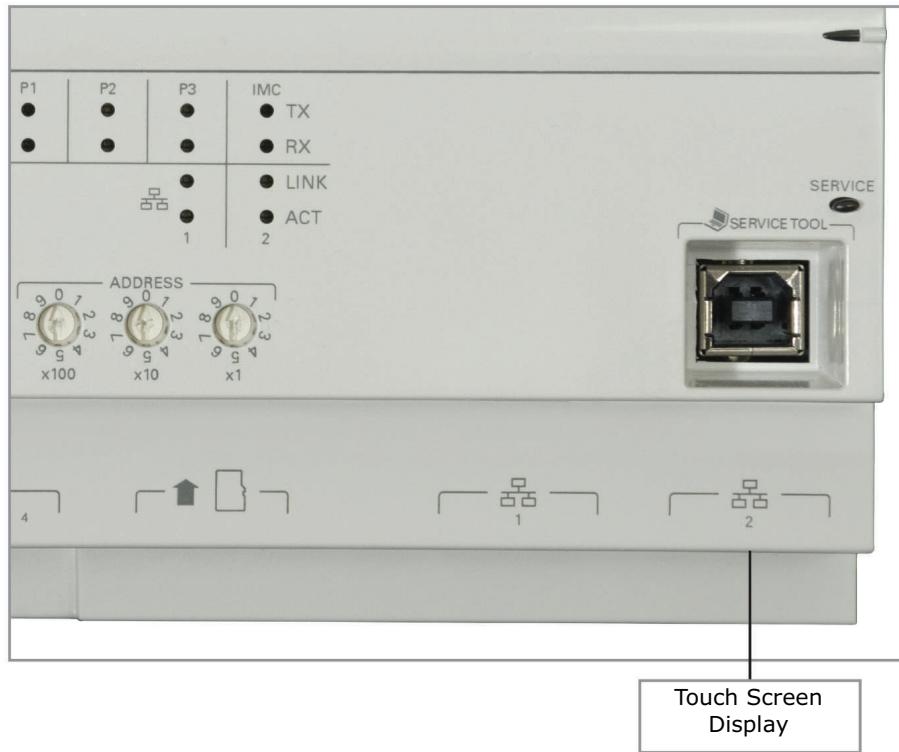

**Note:** Ethernet Port 2 is for use with the Touch Screen display only. Communication to other devices is not supported.



Notes

---



## Notes

---



Notes

---

Trane - by Trane Technologies (NYSE: TT), a global innovator - creates comfortable, energy efficient indoor environments for commercial and residential applications. For more information, please visit [trane.com](http://trane.com) or [tranetechnologies.com](http://tranetechnologies.com).

Trane has a policy of continuous product and product data improvements and reserves the right to change design and specifications without notice. We are committed to using environmentally conscious print practices.